



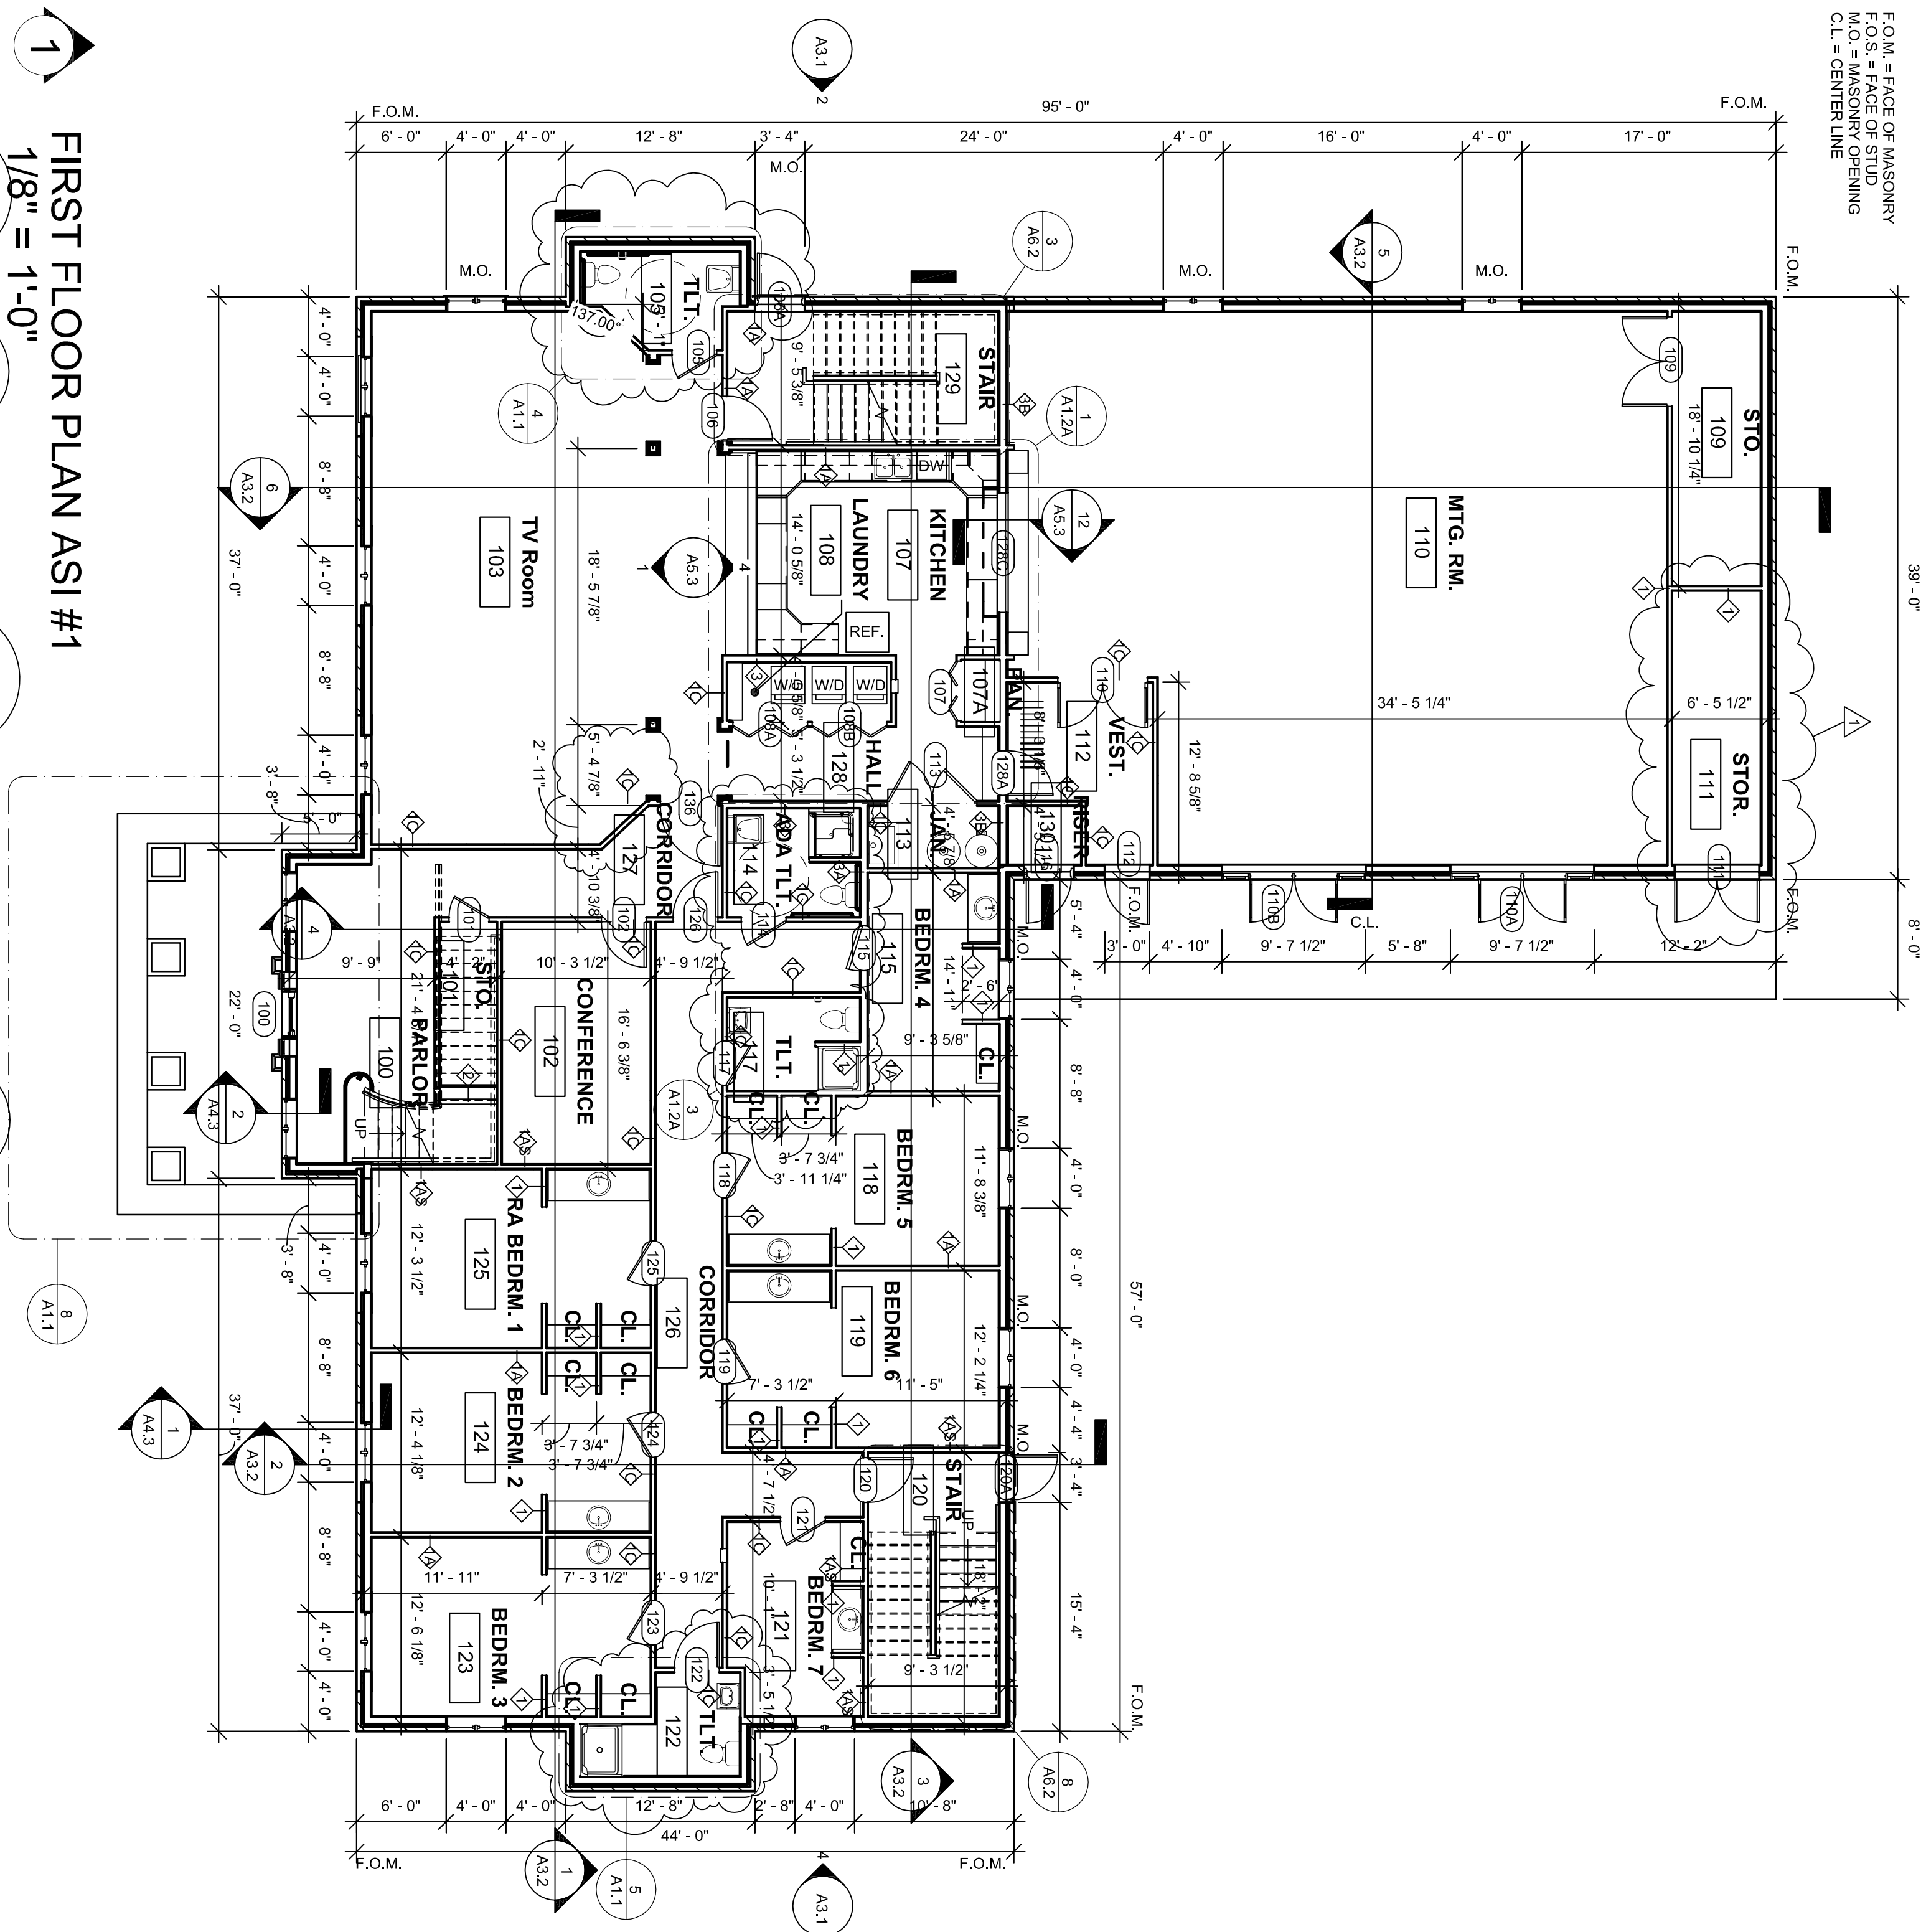

1 FIRST FLOOR PLAN ASI #1
1/8" = 1'-0"

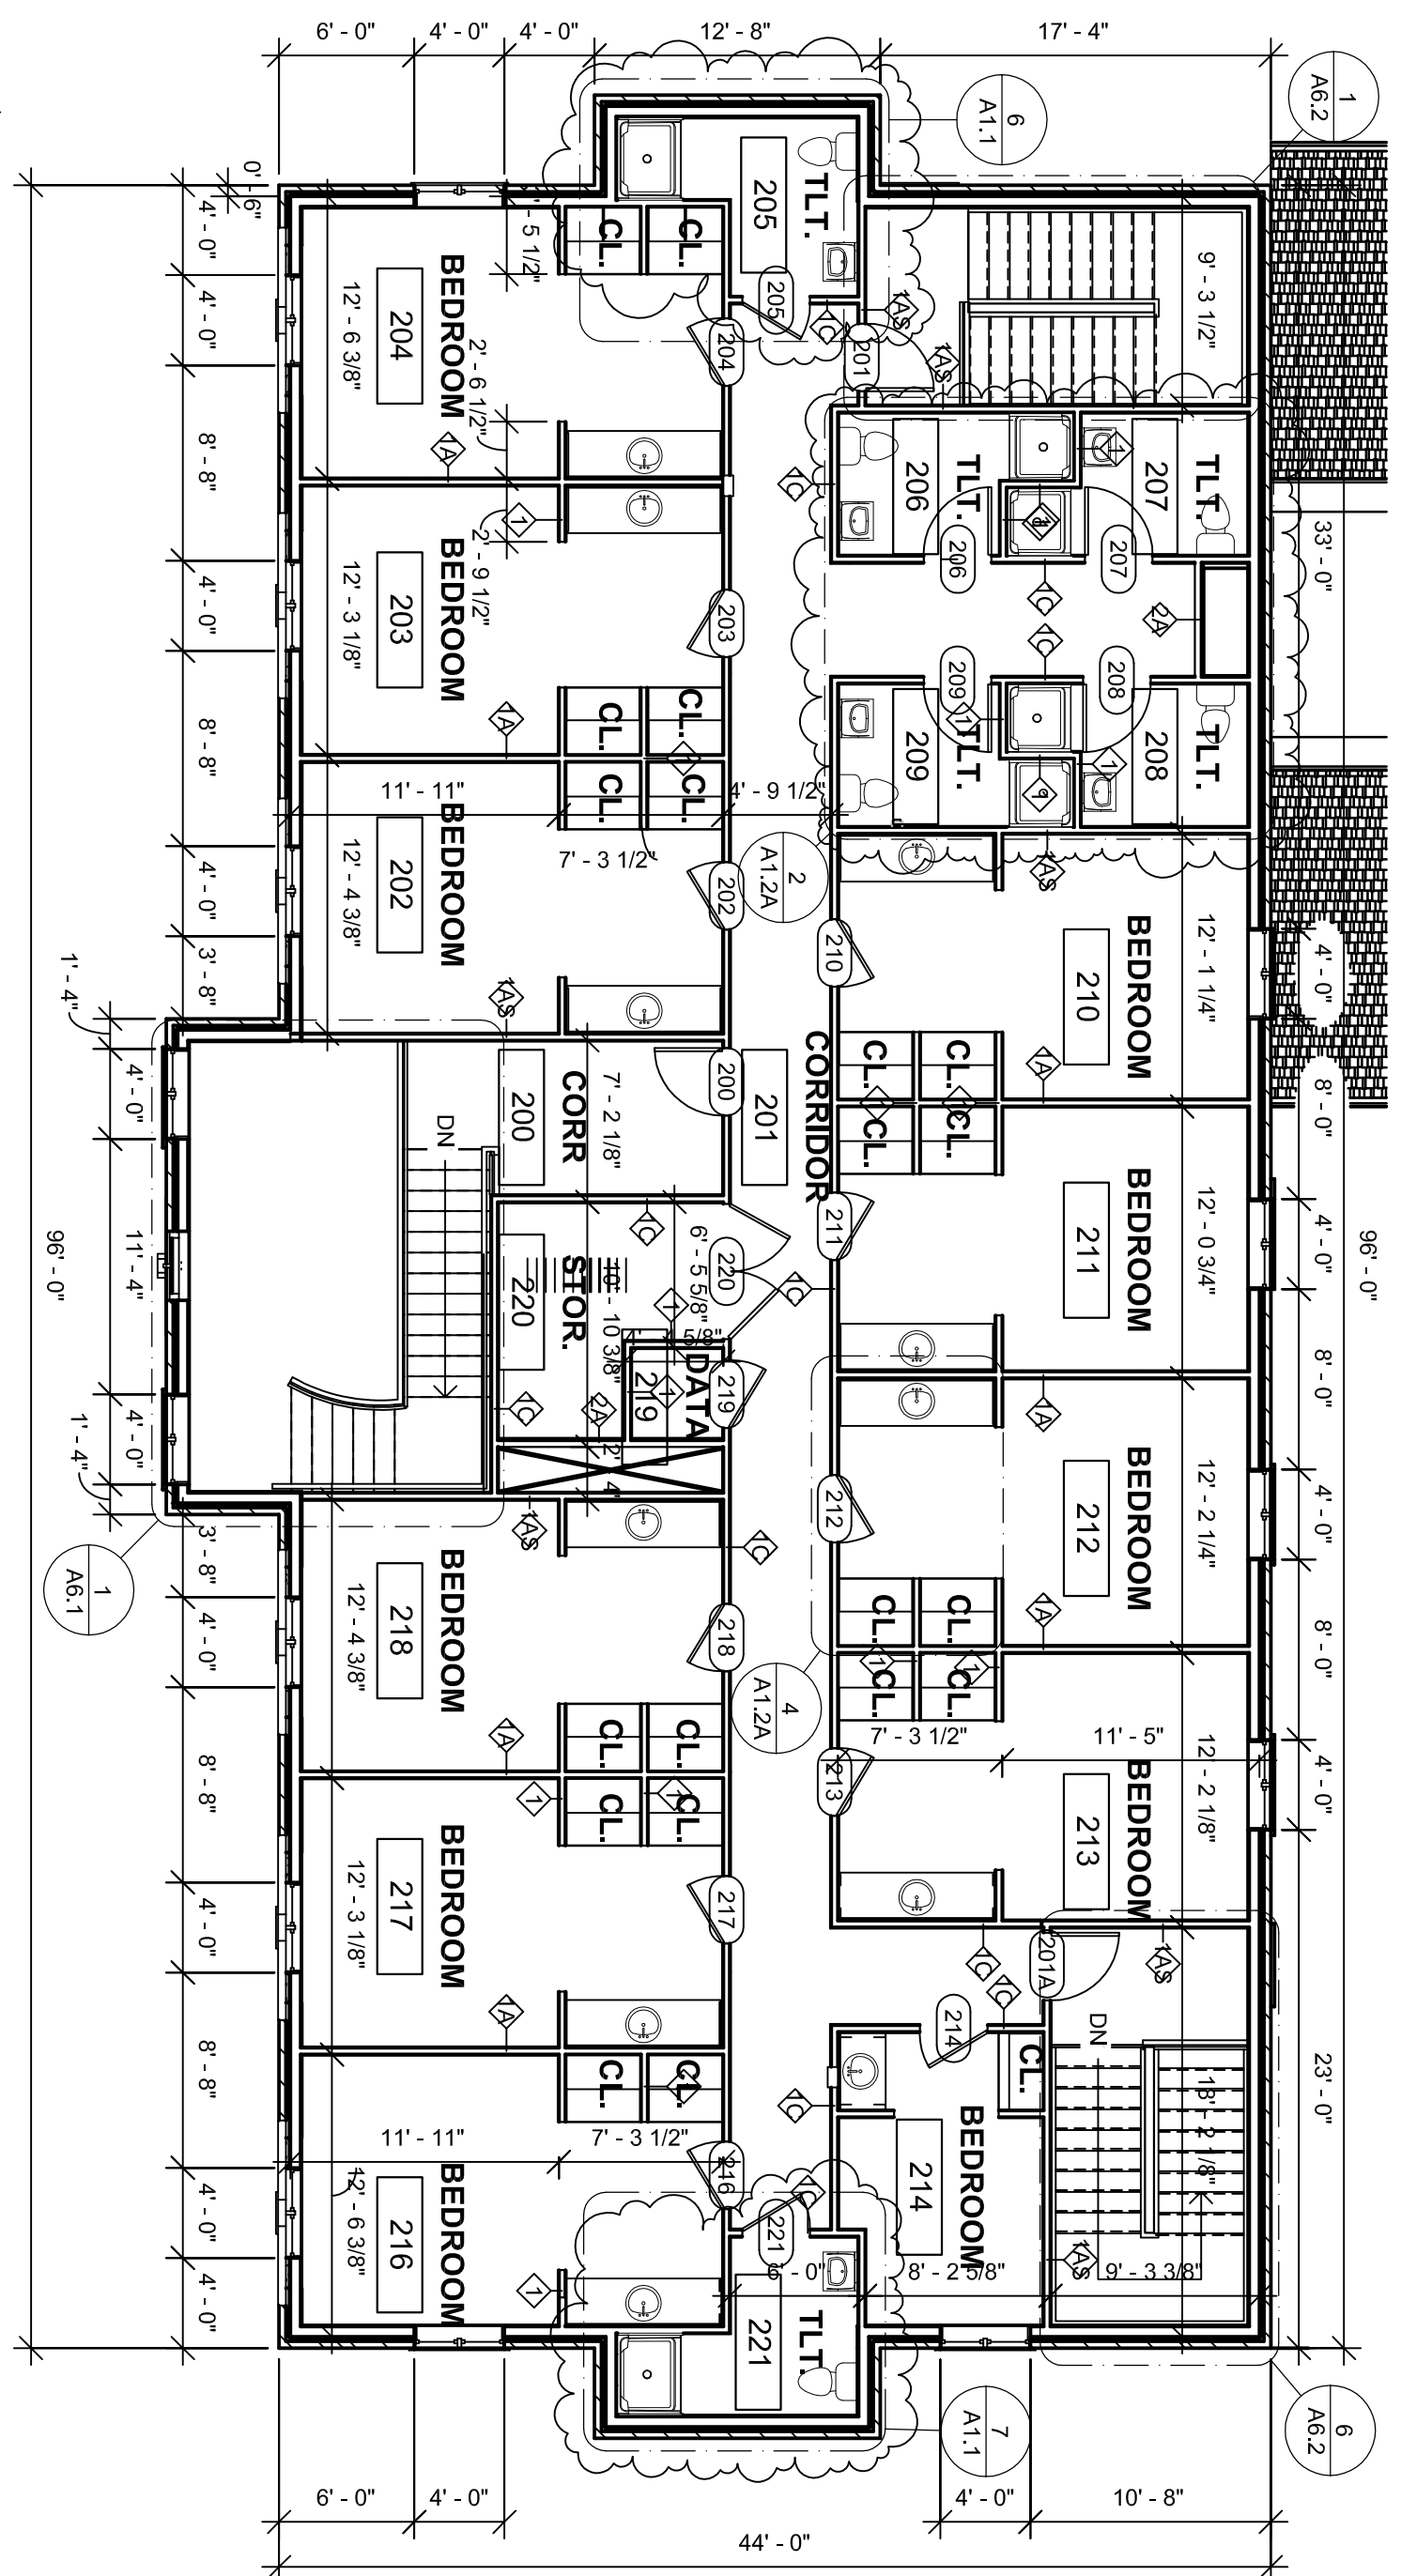

2


SECOND FLOOR PLAN MODEL
1/8" = 1'-0"

- GENERAL NOTES**
1. 1-4H RATED FIRE PARTITION WALLS SEPARATING SLEEPING UNITS TO BE FIRE RATED FROM FLOOR UP TO FIRE RATED CEILING MEMBRANE OR FIRE RATED FLOOR/CEILING DECK ASSEMBLY.
2. 30 MINUTE RATED FIRE PARTITION WALLS SEPARATING


1. FIRE RATED GLASS ASSEMBLY
2. 1 1/4" RATED FIRE BARRIER WALL S.T. EXIT STAIR ENCLOSURES
3. SHAFR ENCLOSURE WALLS TO BE FIRE RATED FROM FLOOR TO FLOOR DECK
4. 2 1/4" RATED FIRE BARRIER WALL AT OCCUPANCY
5. SEPARATING WALL BETWEEN A3 AND R2 TO BE FIRE RATED FROM FLOOR TO FLOOR DECK
6. ALL GYP AND GYP SHEATHING TO BE TYPE "X" PER SPECIFICATION
7. FIRE RATED CORRIDOR EXIT ACCESS AND STAIR EXIT ENCLOSURES ARE INDICATED GRAPHICALLY ON LIFE SAFETY PLANS G-1 AND G-15.

**NOTES FOR SOUND AND FIRE RATED PARTITIONS FOR WALLS
SEPARATING SLEEPING UNITS AND CORRIDOR WALLS**


2. BUTT-SEAL ELECTRICAL PENETRATIONS OF THE SHEETS TO THE WALLBOARD. SEAL THE JOINTS BETWEEN THE BACKS OF THE BOXES AND JOINTS BETWEEN THE BOXES OF THE WALLBOARD SHALL BE SEALED WITH ACOUSTICAL SEALANT.
3. ISOLATE PLUMBING FROM FINISH ELEMENTS AND WALLBOARD AND SEAL ALL PENETRATIONS OF WALLBOARD WITH ACOUSTICAL SEALANT.
3. ALL THROUGHT PENETRATIONS AND GAPS AROUND THE PERIMETER OF THE SEPARATION WALLS ARE TO BE FREE STOPPED PER SPECIFICATIONS. REFER TO THE MECHANICAL AND ELECTRICAL DRAWINGS FOR PROTECTION OF DUCT OPENING AND FRESH OPENING OF PIPES AND CONDUNTS.
4. ABOVE CEILINGS, ENSURE ALL GYP JOINTS ARE STAGECRESTED AND TYPED, AND NAIL/SCREW HOLES ARE FILLED WITH JOINT COMPOUND.

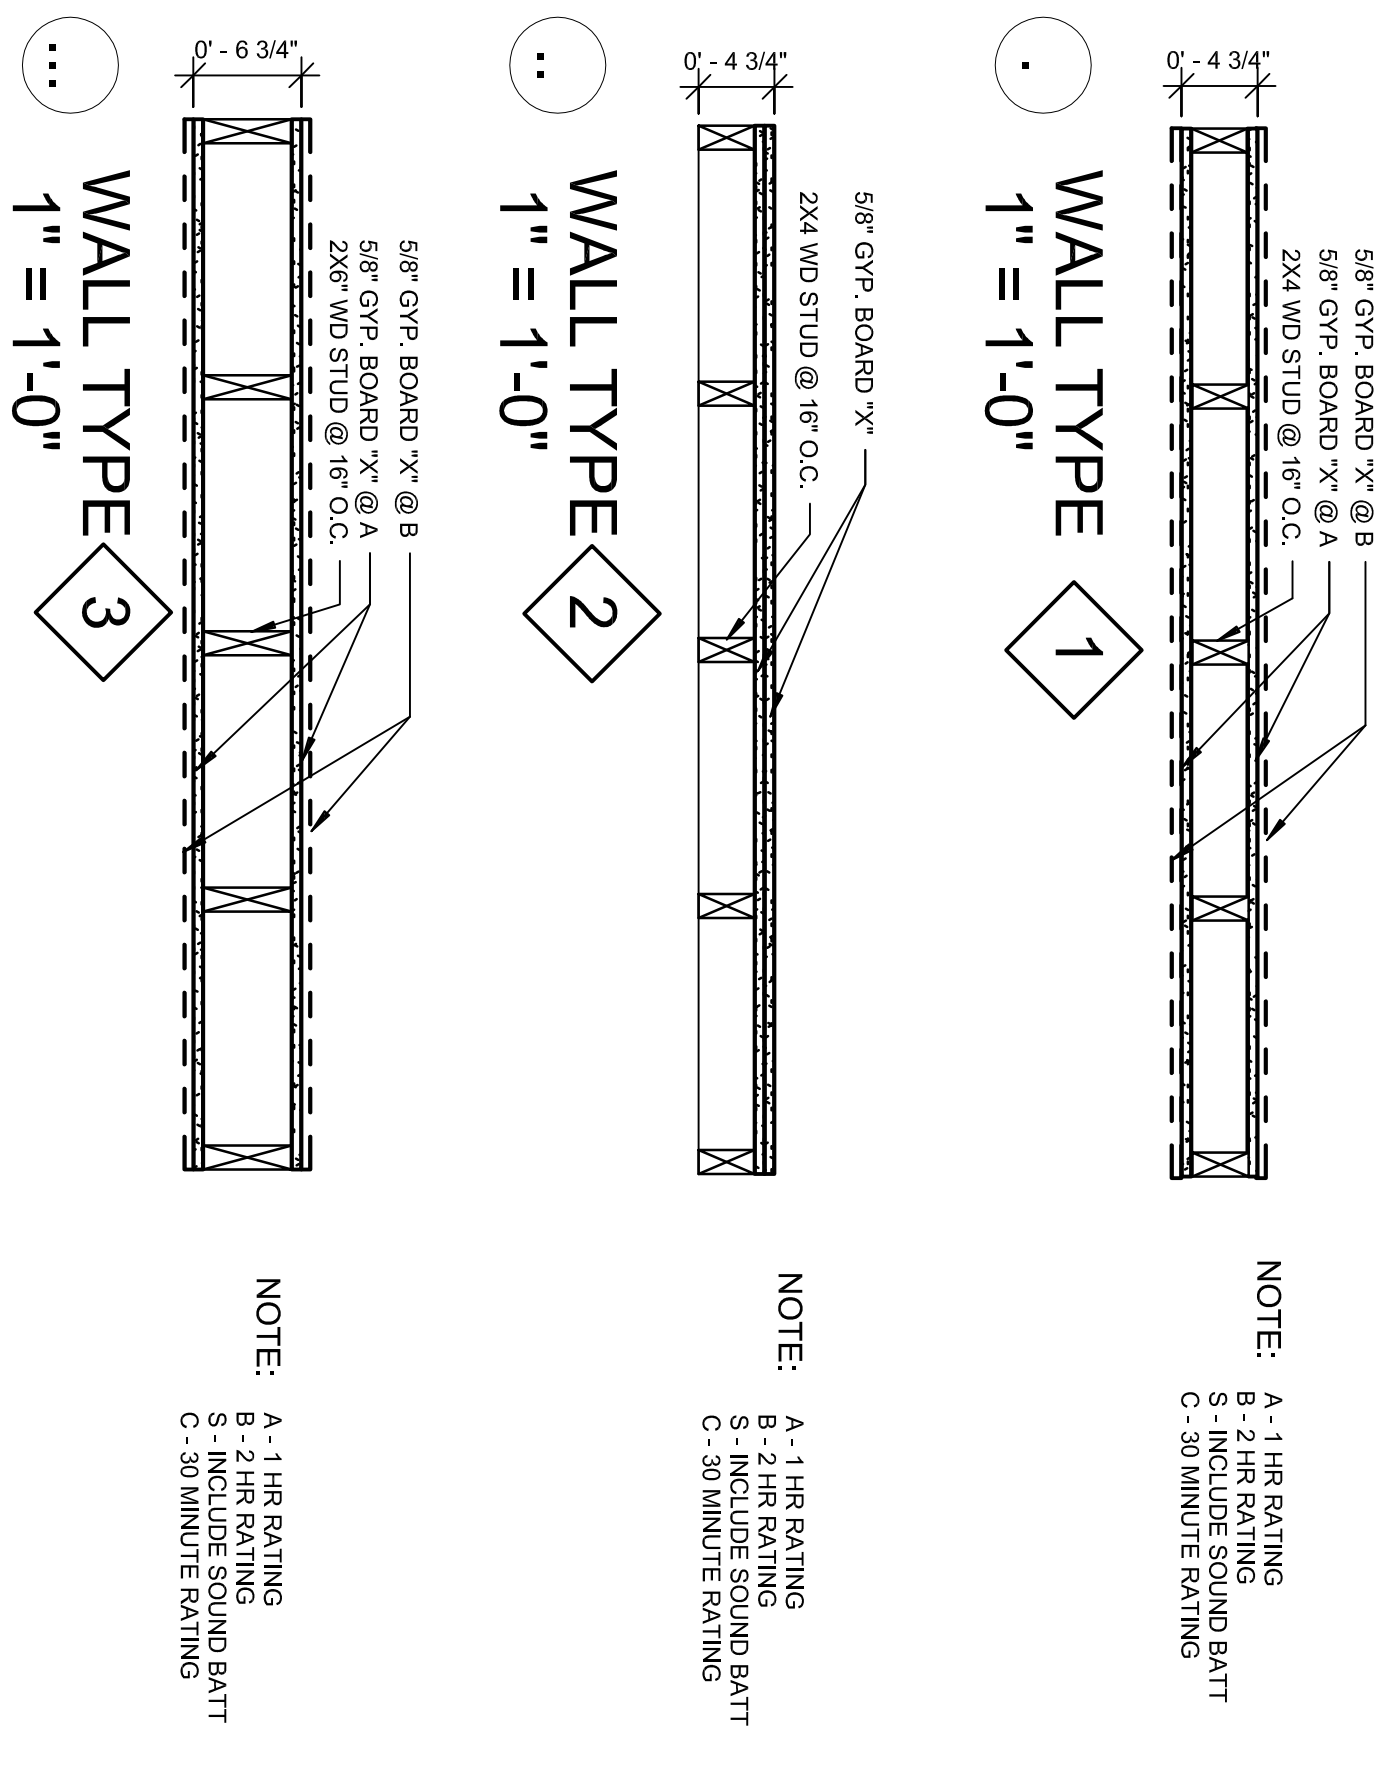


WALL TYPE 3
1" = 1'-0"

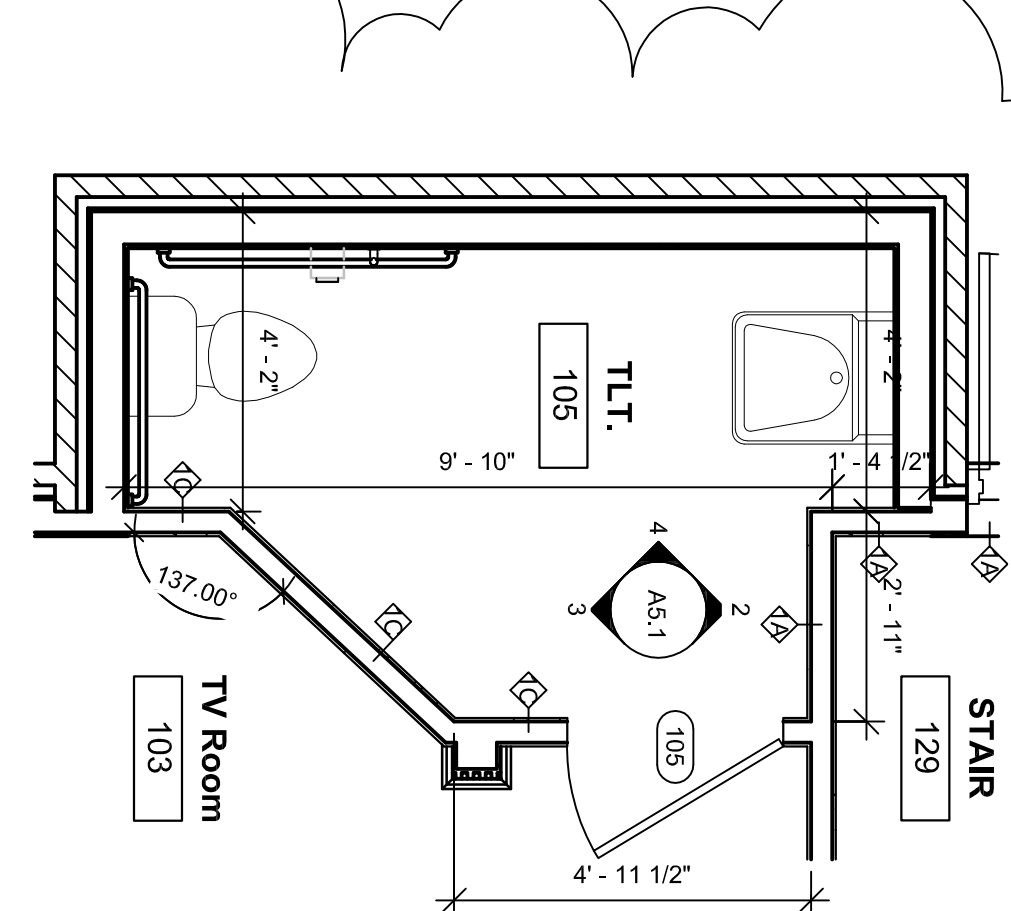


TLT. 105
3/8" = 1'-0"

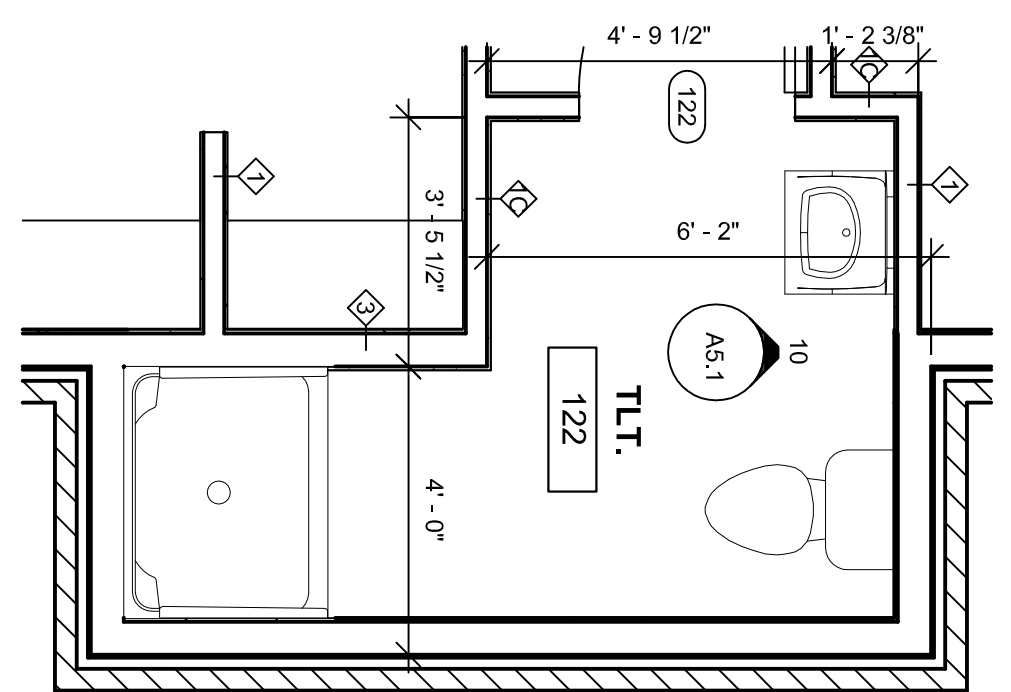


TLT. 122
3/8" = 1'-0"

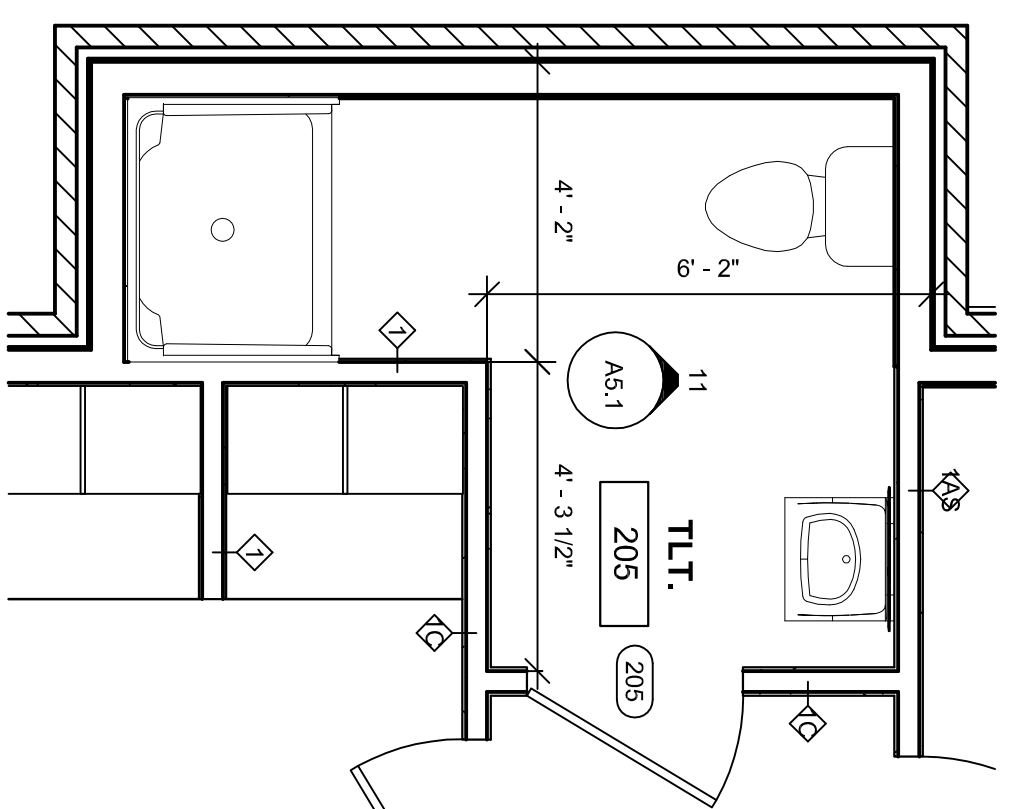

TLT. 205
3/8" = 1'-0"

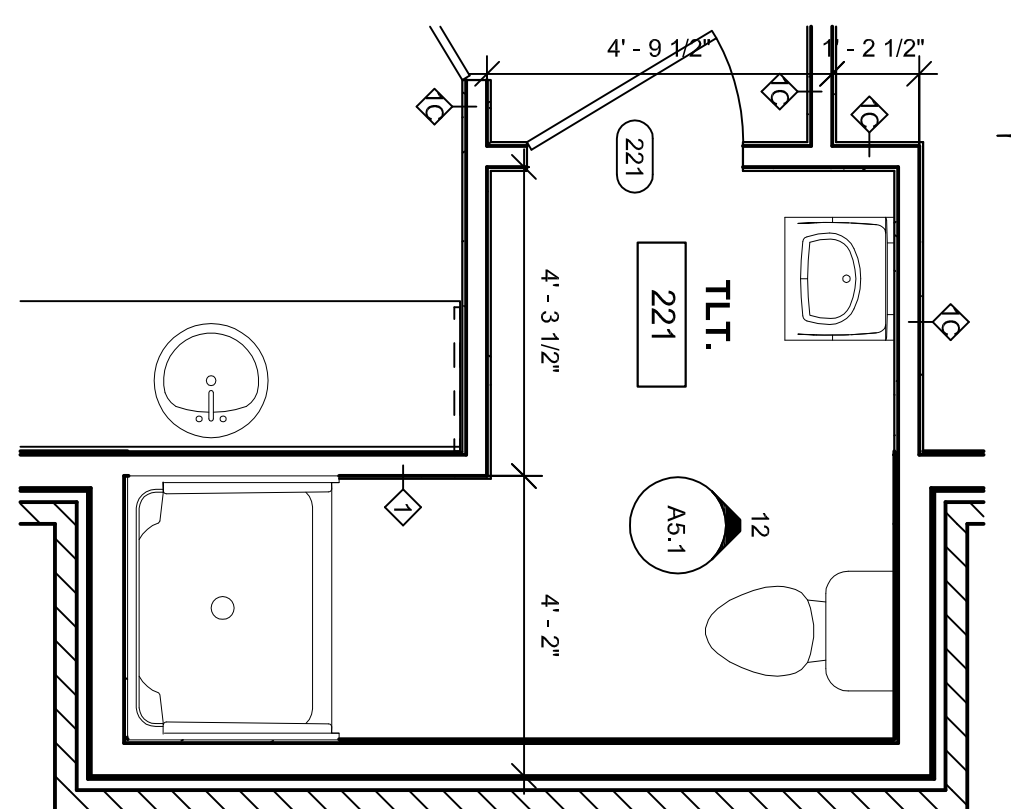

TLT. 221
3/8" = 1'-0"

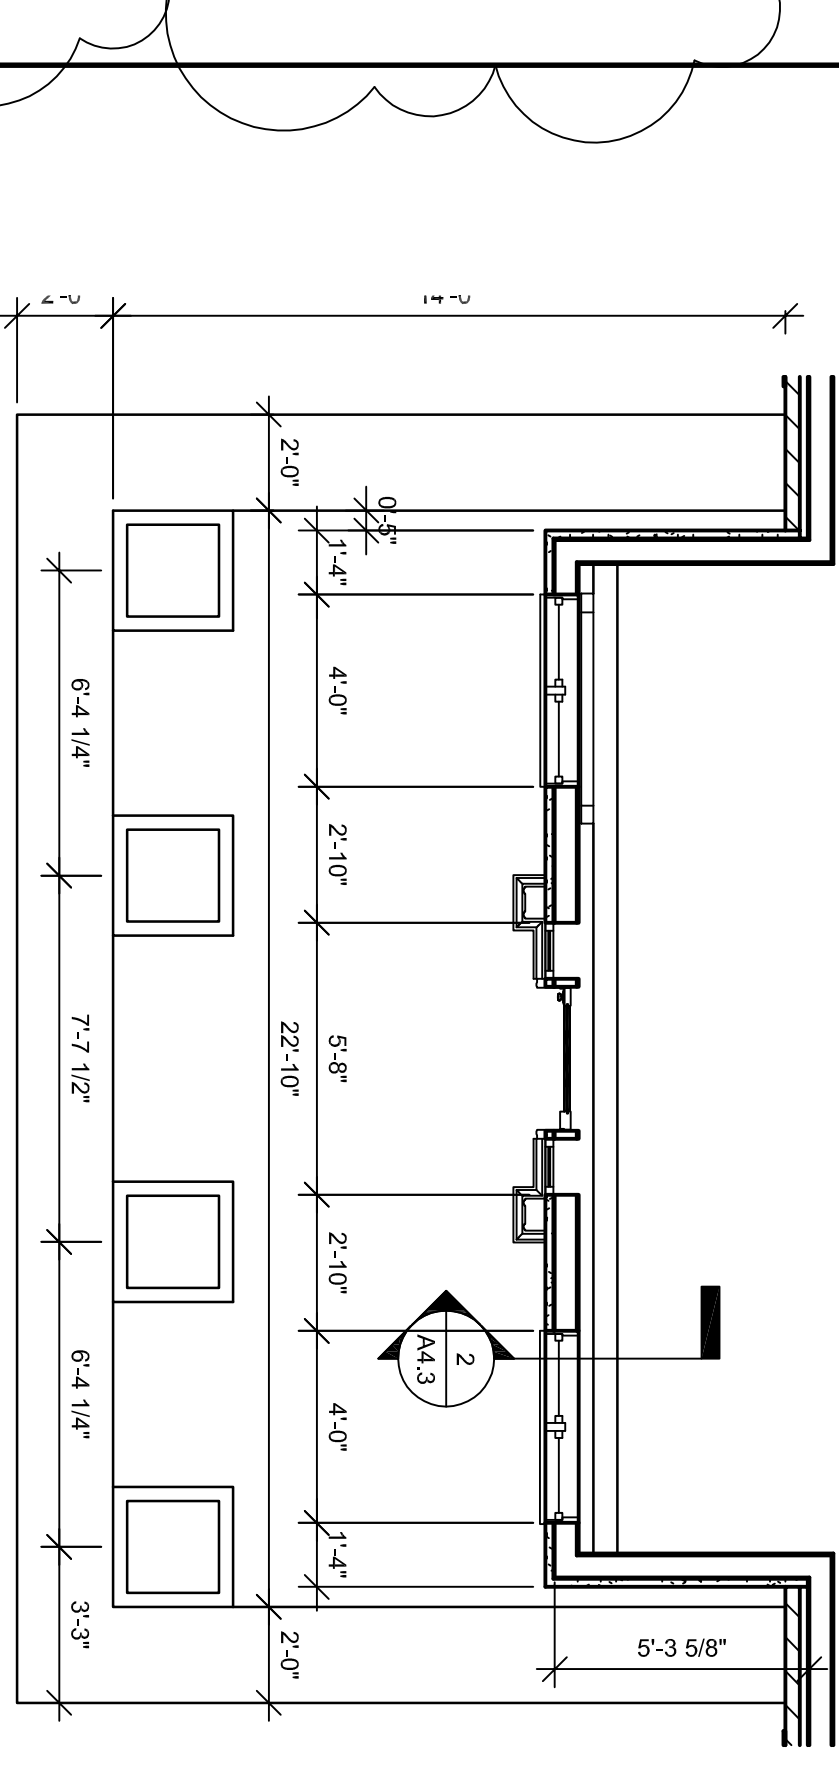

FRONT PORCH
1/4" = 1'-0"