



F.O.M. = FACE OF MASONRY
F.O.S. = FACE OF STUD
M.O. = MASONRY OPENING
C.L. = CENTER LINE

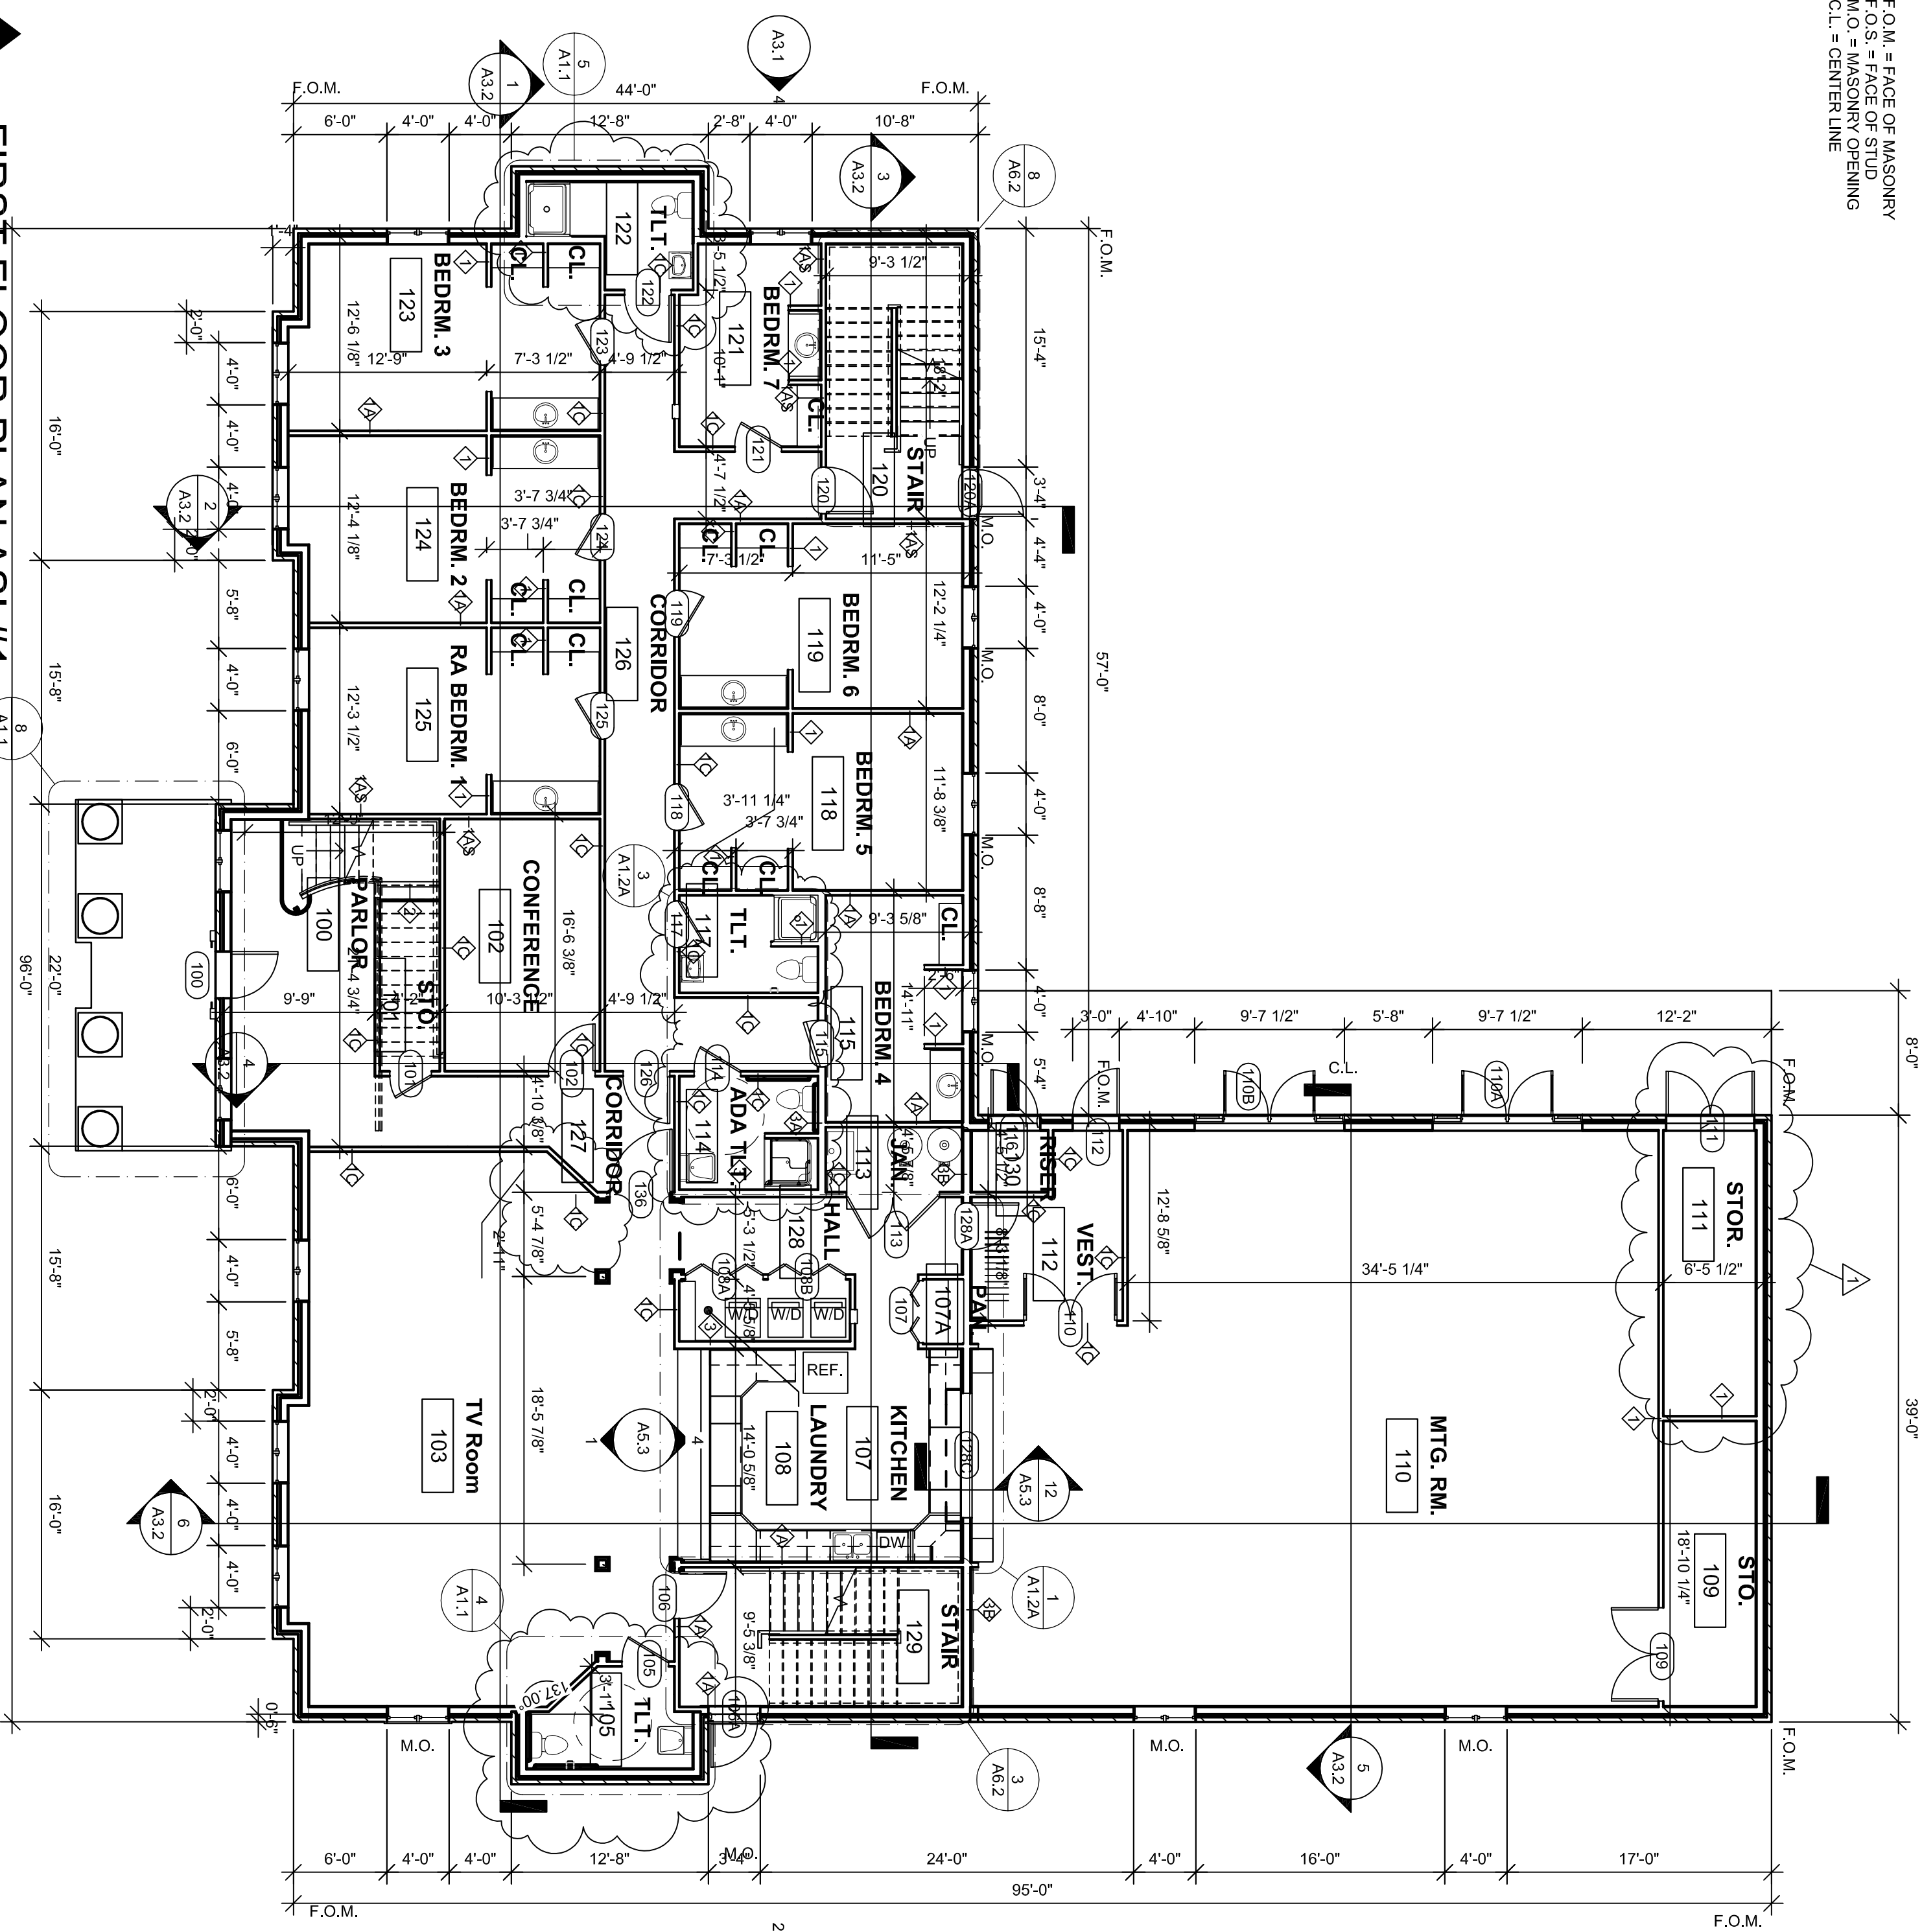

1
FIRST FLOOR PLAN ASI #1
1/8" = 1'-0"

2
SECOND FLOOR PLAN MODEL
1/8" = 1'-0"

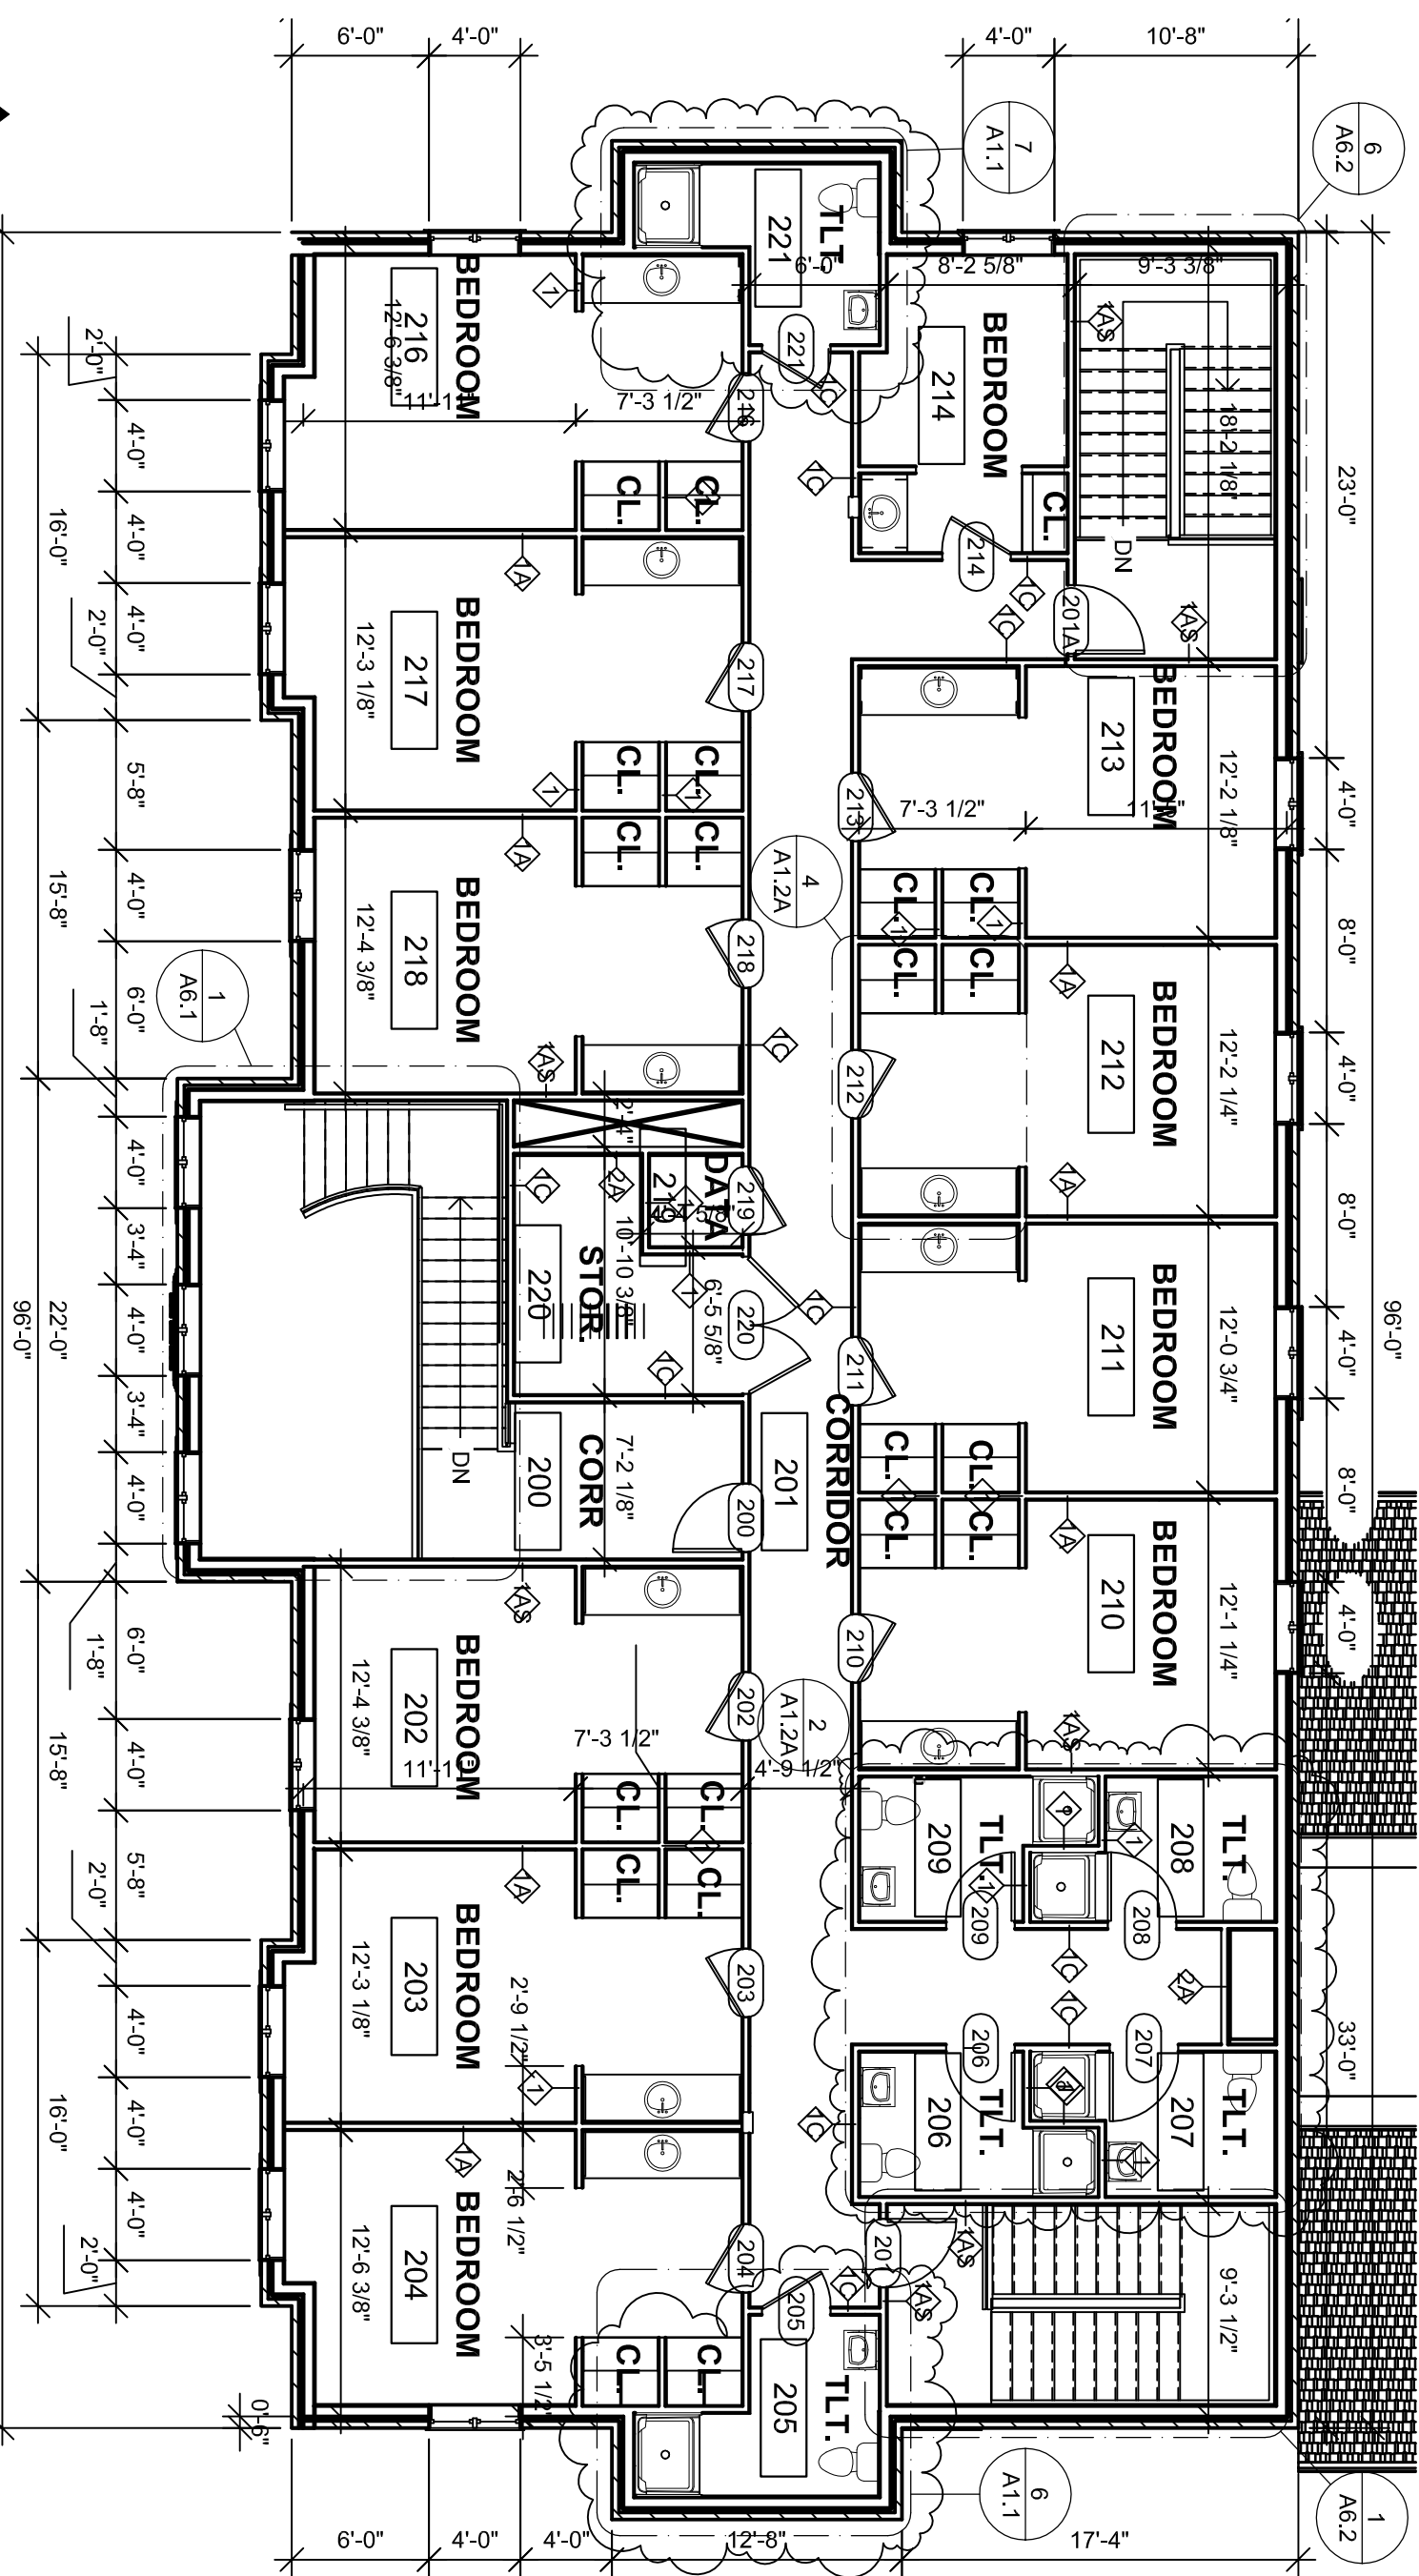

- GENERAL NOTES**
- 1-HR RATED FIRE PARTITION WALLS SEPARATING SLEEPING UNITS TO BE FIRE RATED FROM FLOOR UP TO FIRE RATED CEILING MEMBRANE OR FIRE RATED FLOOR/CEILING DECK ASSEMBLY.
 - 30 MINUTE RATED FIRE PARTITION WALLS SEPARATING CORRIDOR FROM SLEEPING UNITS TO BE FIRE RATED FROM FLOOR UP TO FIRE RATED CEILING MEMBRANE OR FIRE RATED FLOOR/CEILING DECK ASSEMBLY.
 - 1-HR RATED FIRE BARRIER WALLS AT EXIT STAIR ENCLOSURES, SHAFT ENCLOSURES WALLS TO BE FIRE RATED FROM FLOOR TO FLOOR DECK.
 - 2-HR RATED FIRE BARRIER WALLS AT OCCUPANCY SEPARATING WALL BETWEEN A3 AND R2 TO BE FIRE RATED FROM FLOOR TO FLOOR DECK.
 - ALL GYP BD AND GYP SHEATHING TO BE TYPE "X" PER SPECIFICATION.
 - FIRE RATED CORRIDOR EXIT ACCESS AND STAIR EXIT ENCLOSURES ARE INDICATED GRAPHICALLY ON LIFE SAFETY PLANS G1.4 AND G1.5.
- NOTES FOR SOUND AND FIRE RATED PARTITIONS FOR WALLS SEPARATING SLEEPING UNITS AND CORRIDOR WALLS**
- OFFSET ELECTRICAL OR COMMUNICATIONS OUTLETS BOXES BY AT LEAST ONE STUD SPACE. ALL OPENING IN THE SIDE OF THE WALL BOARD MUST BE SEALED WITH ACOUSTICAL SEALANT.
 - ISOLATE PLUMBING FROM FRAMING ELEMENTS AND ACOUSTICAL SEALANT.
 - ALL THROUGH PENETRATIONS AND GAPS AROUND THE PERIMETER OF FIRE SEPARATION WALLS ARE TO BE FIRE STOPPED PER SPECIFICATIONS. REFER TO THE MECHANICAL AND ELECTRICAL DRAWINGS FOR PROTECTION OF DUCT OPENING AND FRESH/OPENING OF PIPES AND CONDUITS.
 - ABOVE CEILINGS, ENSURE ALL GYP BD JOINTS ARE STAGGERED AND TAPED AND NAILS/SCREW HOLES ARE FILLED WITH JOINT COMPOUND.

WALL TYPE 1
1" = 1'-0"

5/8" GYP. BOARD "X" @ B
5/8" GYP. BOARD "X" @ A
2X4 WD STUD @ 16" O.C.
NOTE: A - 1-HR RATING
B - 2-HR RATING
S - INCLUDE SOUND BATT
C - 30 MINUTE RATING


WALL TYPE 2
1" = 1'-0"

5/8" GYP. BOARD "X"
2X4 WD STUD @ 16" O.C.
NOTE: A - 1-HR RATING
S - INCLUDE SOUND BATT
C - 30 MINUTE RATING


WALL TYPE 3
1" = 1'-0"

5/8" GYP. BOARD "X" @ B
5/8" GYP. BOARD "X" @ A
2X6 WD STUD @ 16" O.C.
NOTE: A - 1-HR RATING
B - 2-HR RATING
S - INCLUDE SOUND BATT
C - 30 MINUTE RATING


4
TLT. 105
3/8" = 1'-0"

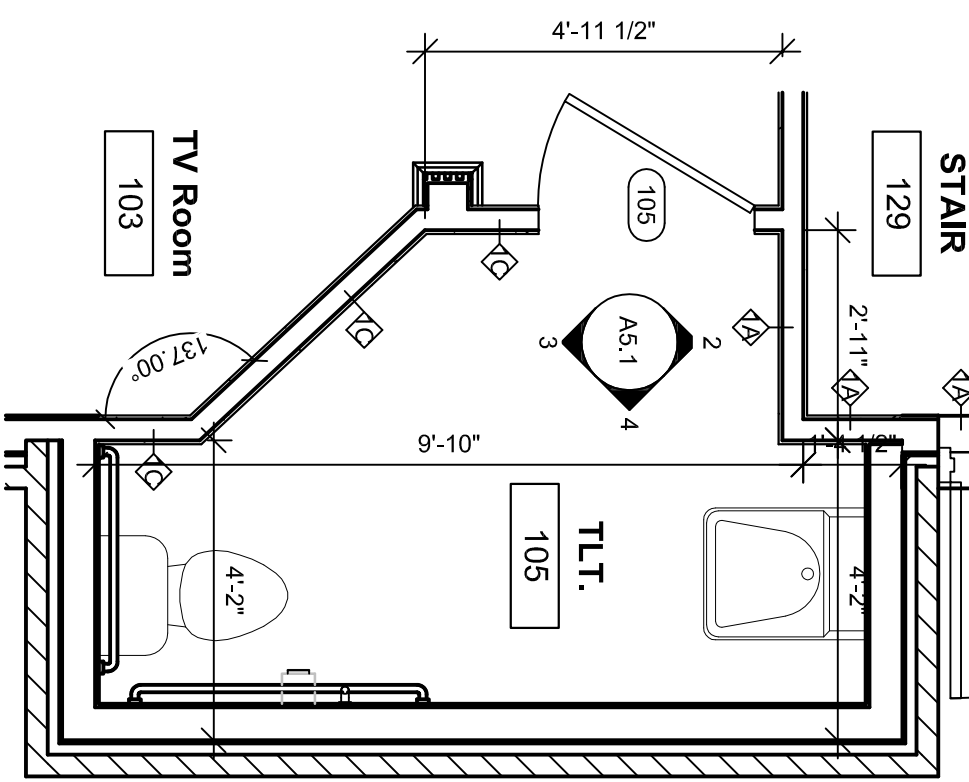


5
TLT. 122
3/8" = 1'-0"

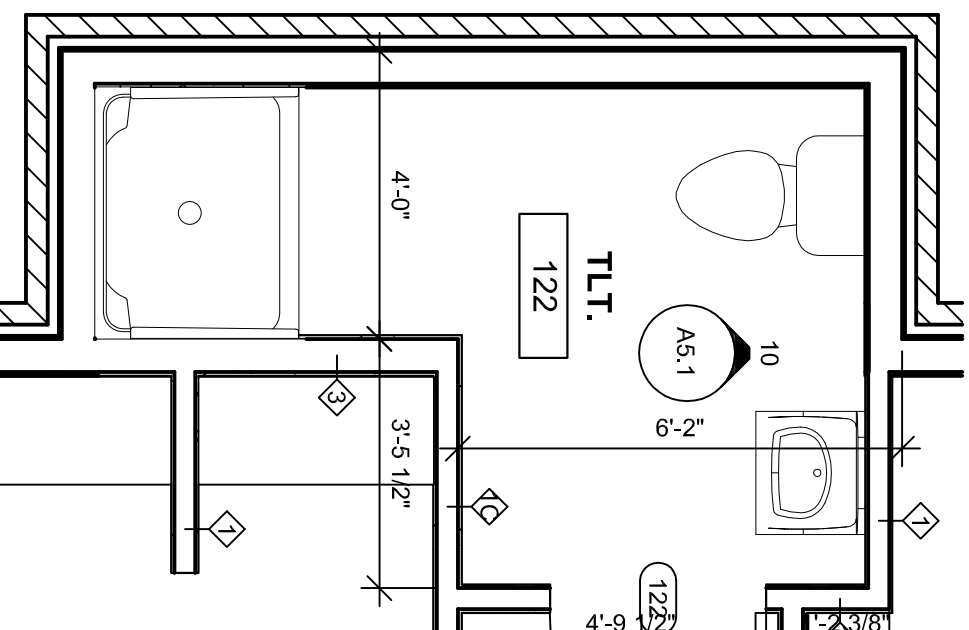


6
TLT. 205
3/8" = 1'-0"

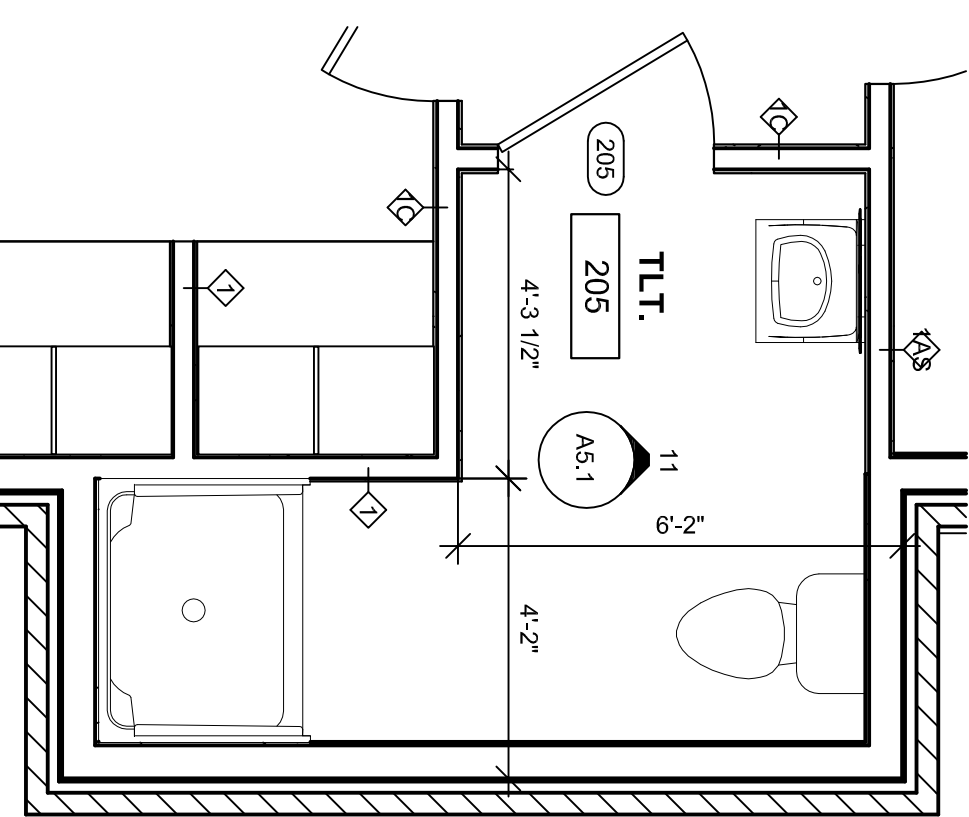

7
TLT. 221
3/8" = 1'-0"

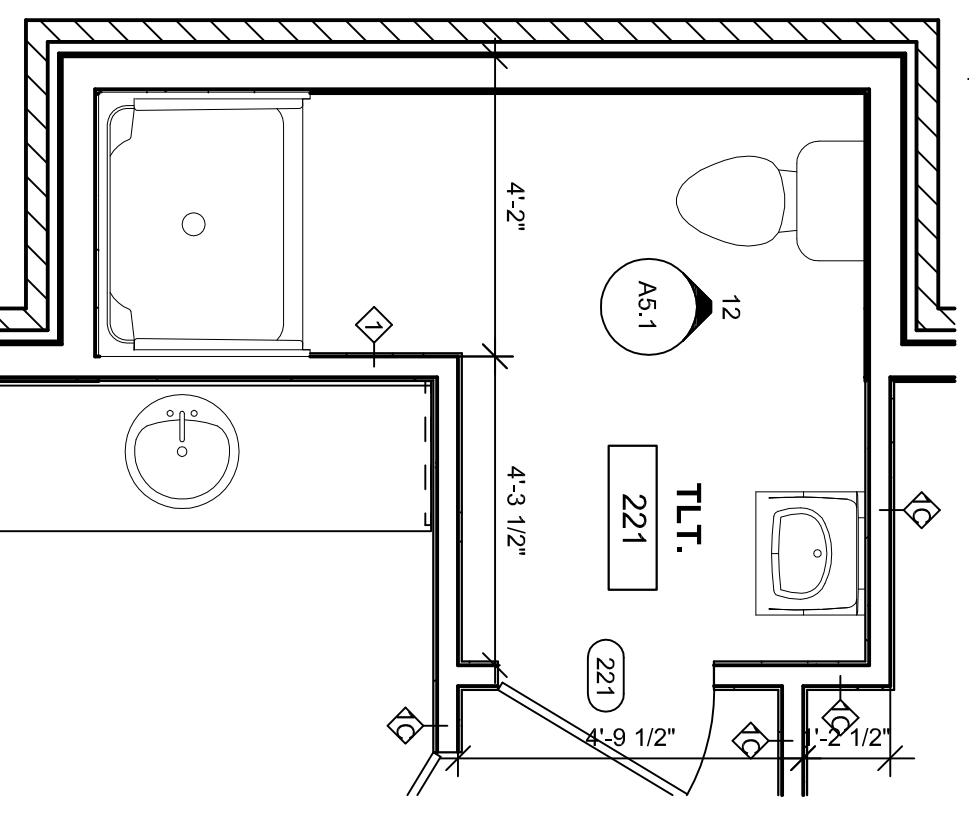

8
FRONT PORCH
1/4" = 1'-0"

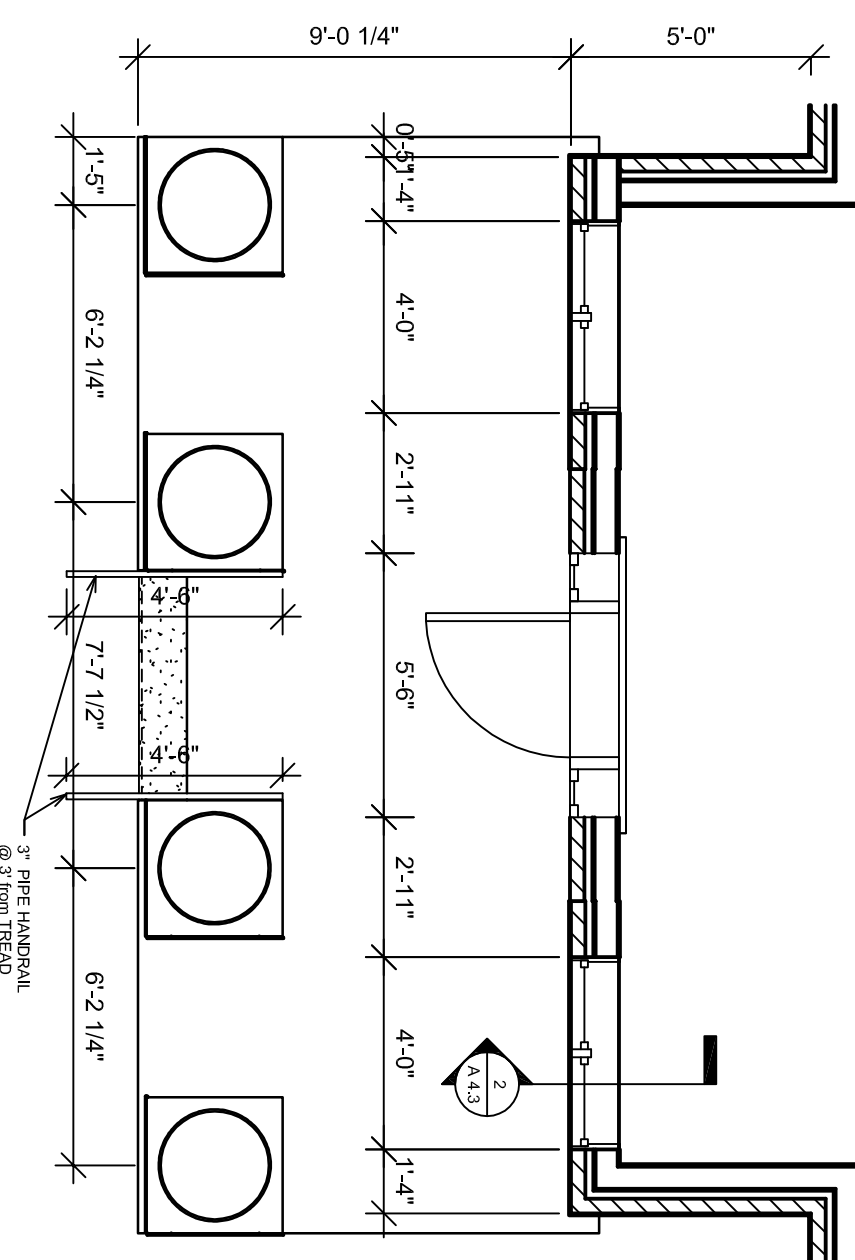

REVISION:
Addendum #1 - 06/09/2014

UCA GREEK VILLAGE SORORITY HOUSE DESIGN 3

Conway, Arkansas 72204



PROJECT NUMBER: CM42.12
SHEET ISSUE DATE: 06/10/14
PAGE TITLE: 1ST / 2ND FLOOR PLANS
SHEET NUMBER: A1.1