




REVISION:
Addendum #1 - 06/09/2014

UCA GREEK VILLAGE SORORITY HOUSE DESIGN 4

Conway, Arkansas 72204

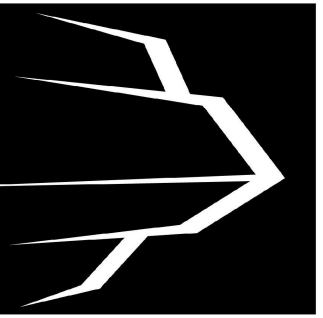

CARADINE
COMPANIES
ARCHITECTURE




PROJECT NUMBER:
CM2.12

SHEET ISSUE DATE:
06/10/14

PAGE TITLE:
1ST / 2ND FLOOR
PLANS


SHEET NUMBER:
A1.1

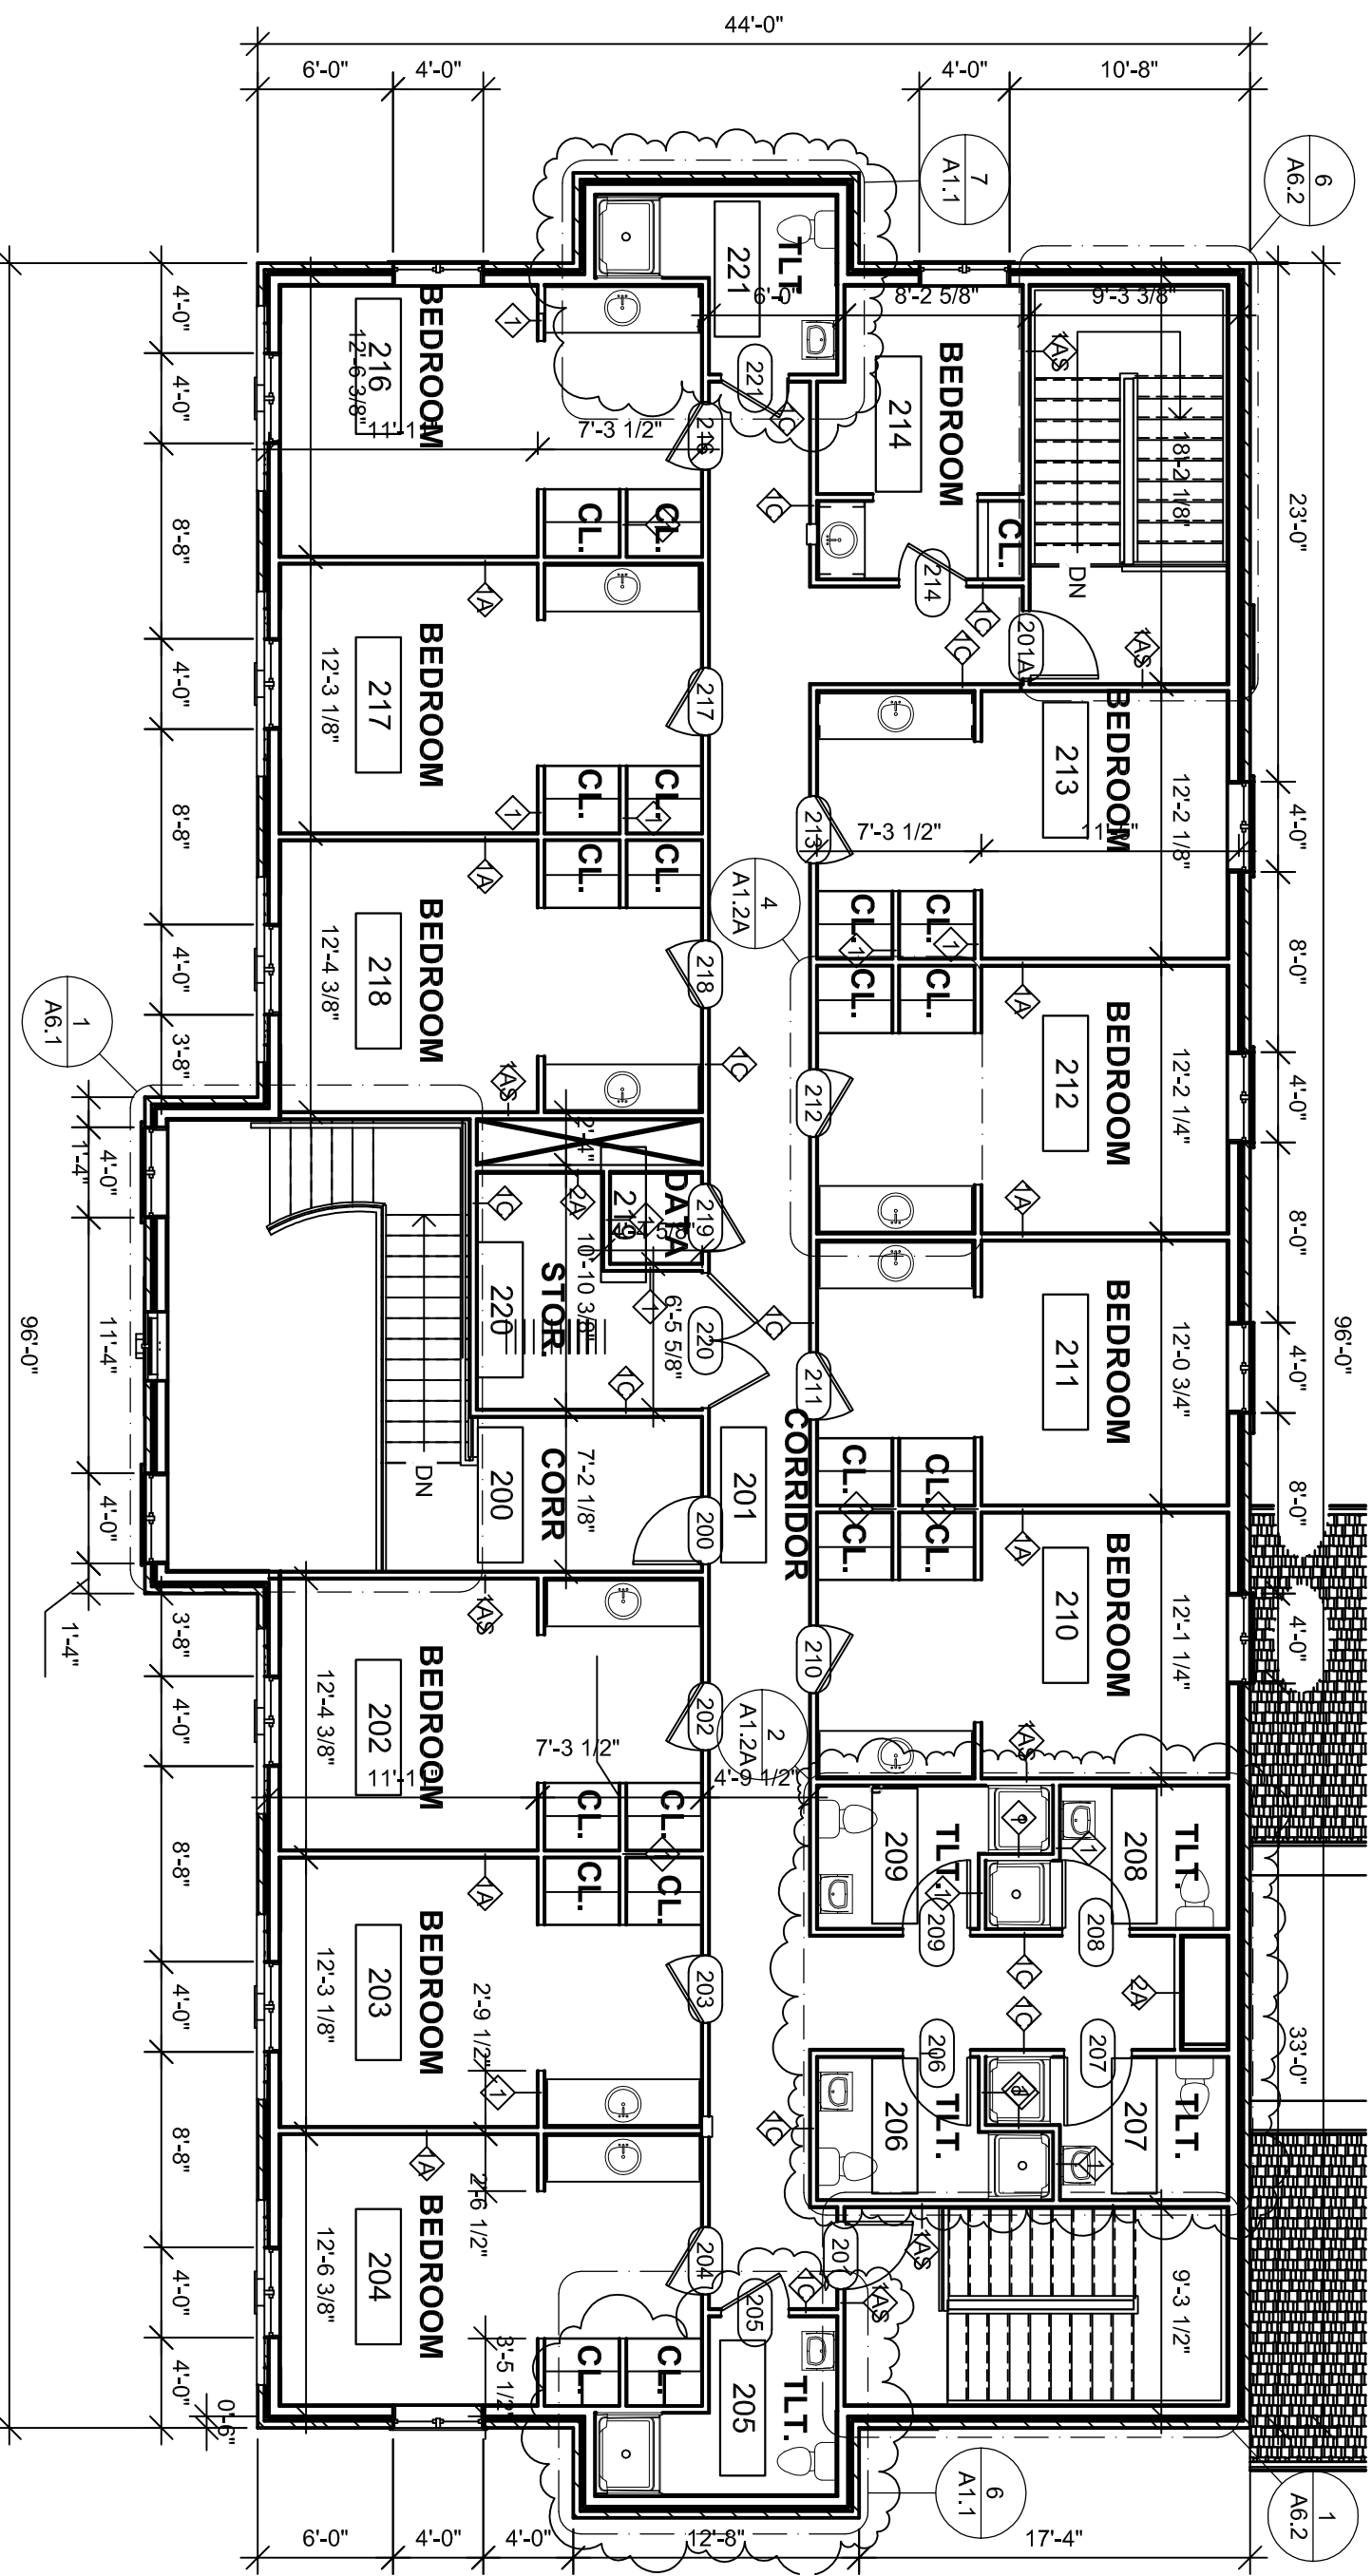


2 SECOND FLOOR PLAN MODEL
1/8" = 1'-0"

GENERAL NOTES


- 1-HR RATED FIRE PARTITION WALLS SEPARATING SLEEPING UNITS TO BE FIRE RATED FROM FLOOR UP TO FIRE RATED CEILING ASSEMBLY.
 2. 30 MINUTE RATED FIRE PARTITION WALLS SEPARATING SLEEPING UNITS TO BE FIRE RATED FROM FLOOR UP TO FIRE RATED CEILING ASSEMBLY.
 - 1-HR RATED FIRE BARRIER WALLS AT EXIT STAIR ENCLOSURES SHOWN TO BE FIRE RATED FROM FLOOR UP TO FLOOR DECK.
 - 2-HR RATED FIRE BARRIER WALLS AT OCCUPANCY ENCLOSURES TO BE FIRE RATED FROM FLOOR TO FLOOR DECK.
 - ALL GYP BD AND GYP SHEATHING TO BE TYPE "X" PER SPECIFICATION.
 - FIRE RATED CORRIDOR EXIT ACCESS AND STAIR EXIT ENCLOSURES ARE INDICATED GRAPHICALLY ON LIFE SAFETY PLANS G1.4 AND G1.5.
- NOTES FOR SOUND AND FIRE RATED PARTITIONS FOR WALLS SEPARATING SLEEPING UNITS AND CORRIDOR WALLS
1. OFFSET ELECTRICAL OR COMMUNICATIONS OUTLET'S BOXES BY AT LEAST ONE STUD SPACE. ALL OPENING IN THE SIDES OF BACKS OF THE BOXES AND JOINTS BETWEEN THE BOXES OF THE WALL BOARD MUST BE SEALED WITH ACOUSTICAL SEALANT.
 2. ISOLATE PLUMBING FROM PENETRATIONS OF WALLBOARD WITH ACOUSTICAL SEALANT.
 3. ALL THROUGH PENETRATIONS AND GAPS AROUND THE PERIMETER OF FIRE SEPARATION WALLS ARE TO BE FIRE RATED WITH ACOUSTICAL SEALANT.
 4. ABOVE CEILINGS ENSURE ALL GYP BD JOINTS ARE STAGGERED AND TAPED AND NAIL/SCREW HOLES ARE FILLED WITH JOINT COMPOUND.

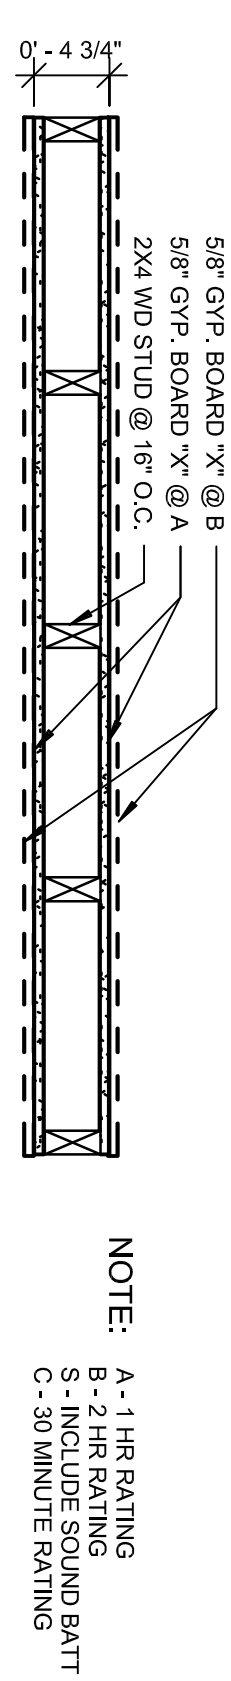

WALL TYPE 1
1" = 1'-0"

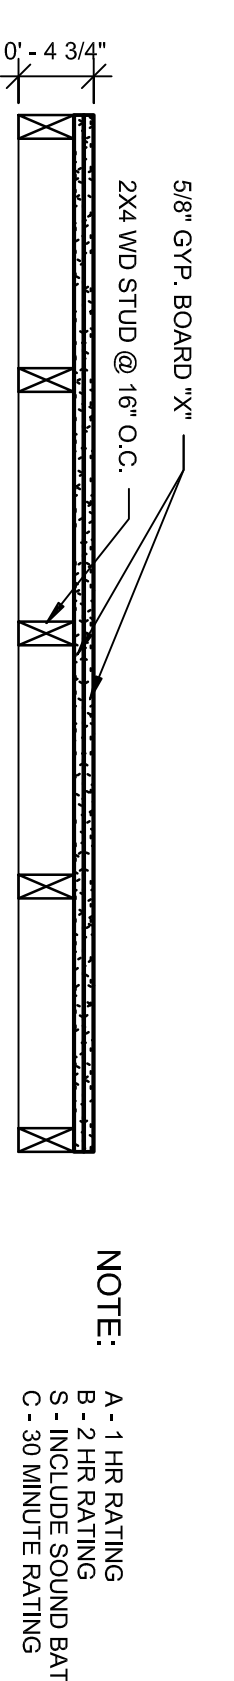



WALL TYPE 2
1" = 1'-0"

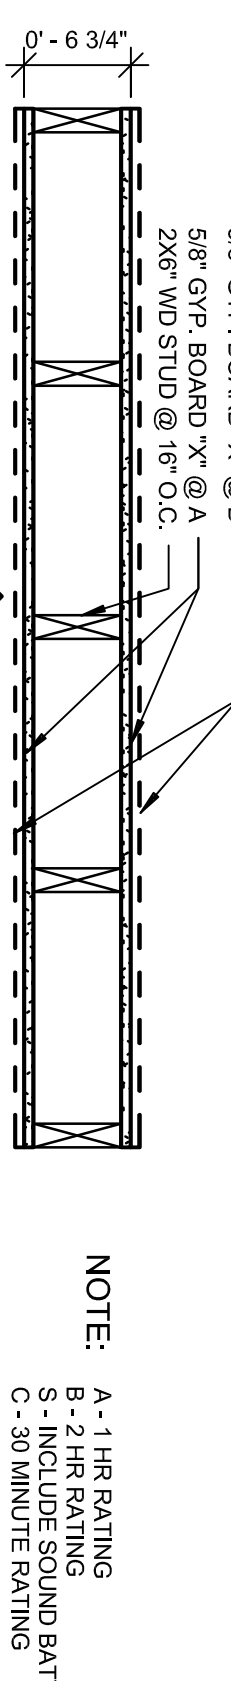

WALL TYPE 3
1" = 1'-0"

...

1 FIRST FLOOR PLAN ASI #1
1/8" = 1'-0"

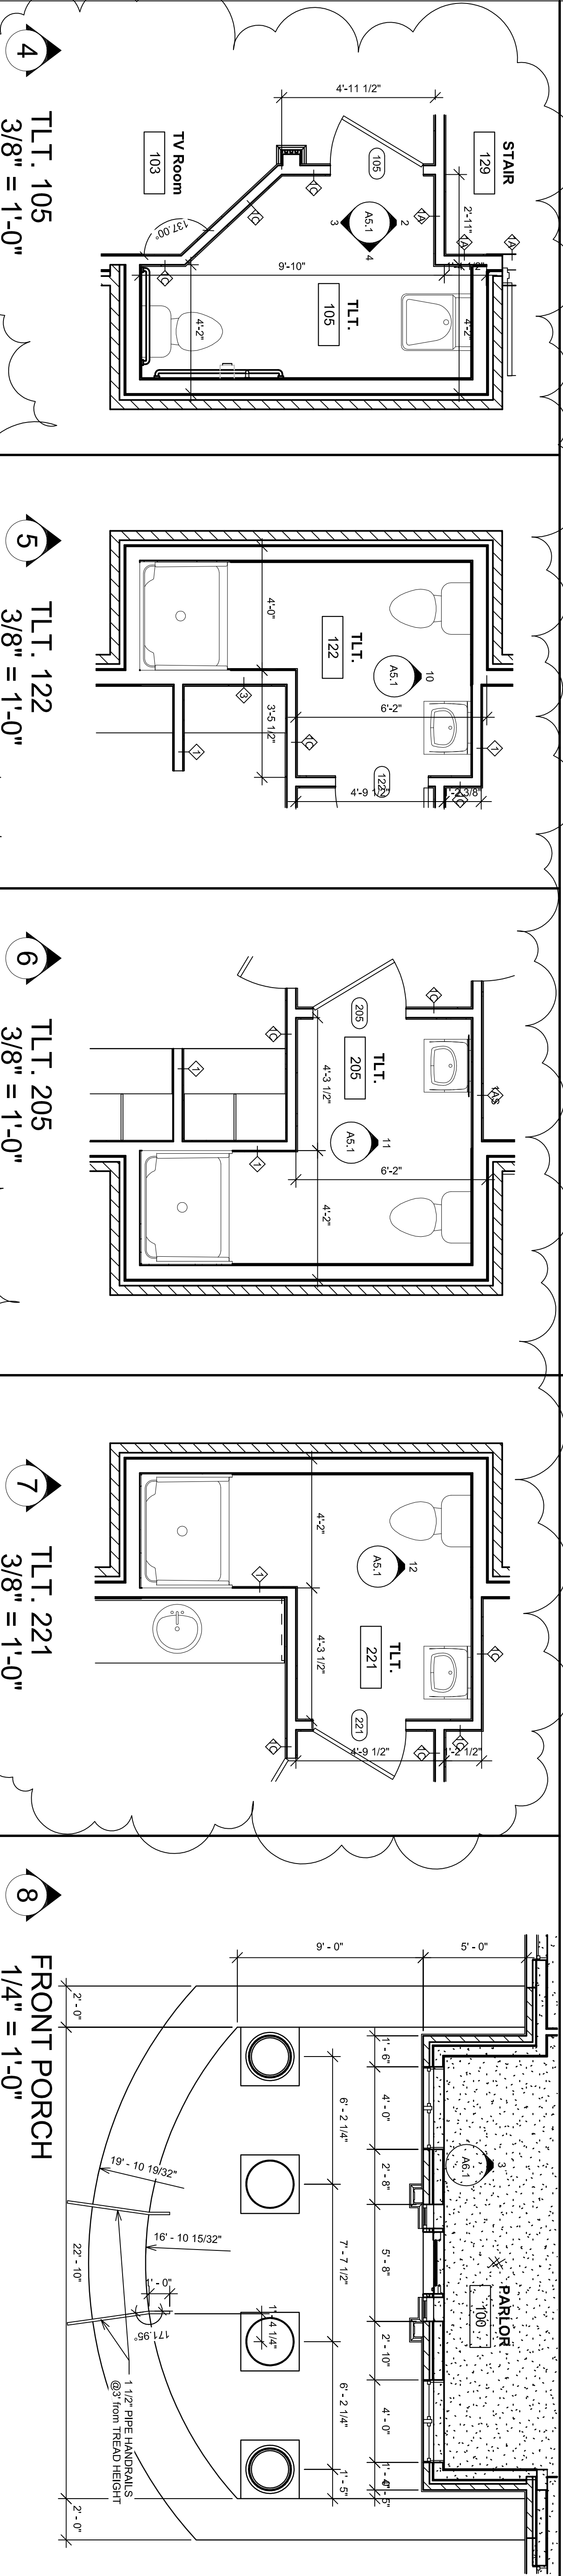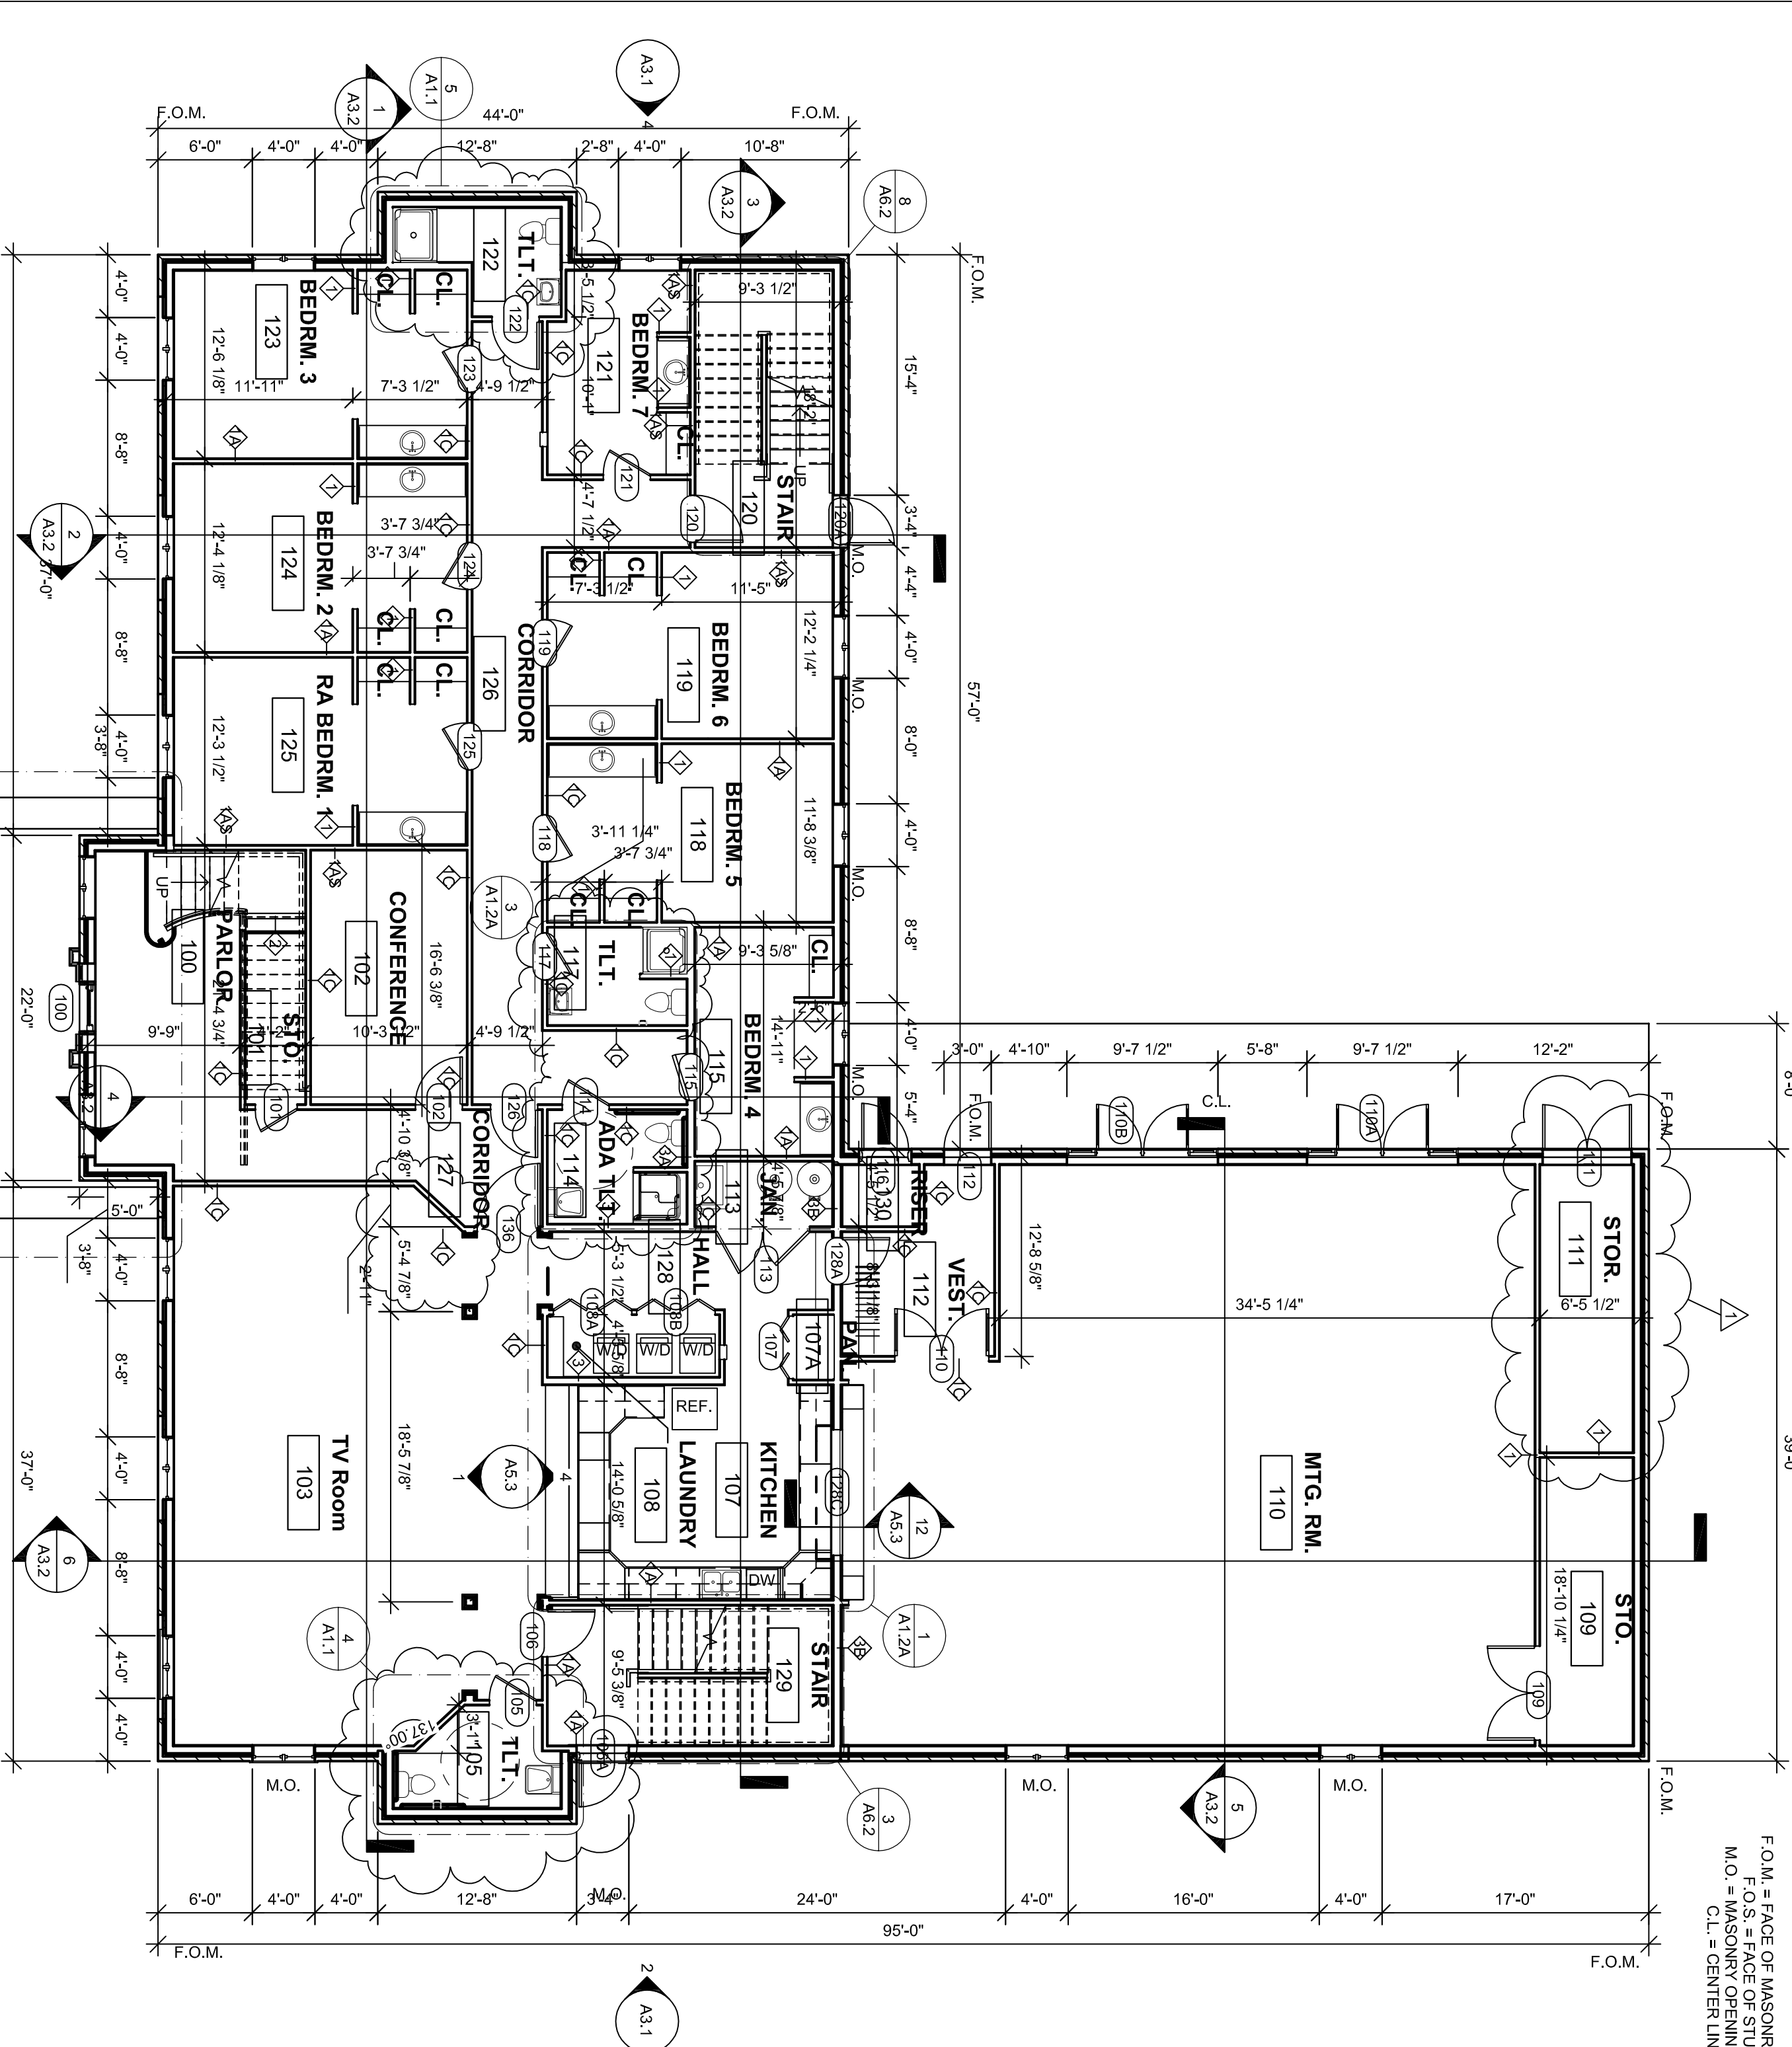

8 FRONT PORCH
1/4" = 1'-0"

7 TLT. 221
3/8" = 1'-0"

6 TLT. 205
3/8" = 1'-0"

5 TLT. 122
3/8" = 1'-0"

4 TLT. 105
3/8" = 1'-0"